



P.O. Box 2758 Windsor, Nova Scotia, B0N 2T0
Ph. 902-798-2261 Fax: 902-798-2557
www.nu-airventilation.com email: nuair@nu-airventilation.com

COMPLIANT SERIES



HRV/ERV PRODUCT MANUAL NU0820/NU2035/NU2540/NU1030

*** LEAVE THIS DOCUMENT WITH THE BUILDING OWNER**

Specifications, dimensions and ratings may change without notice
as a result of ongoing product development and improvements.

Table of Contents

1	<i>ABOUT THE H/ERV</i>	4
2	<i>PRODUCT SELECTION – OPTIONS BY PRODUCT</i>	5
3	<i>Nomenclature, unit configurations, frost control</i>	6
	3.1 Nomenclature – Fishbone Chart	6
	3.2 Unit (duct) Configurations	6
	3.3 Defrost Recommendations	7
4	<i>Sample Specification</i>	8
5	<i>DIMENSIONAL DATA, CLEARANCES</i>	11
	5.1 NU0820	11
	5.2 NU1030	12
	5.3 NU2035	13
	5.4 NU2540	14
	5.5 NU0820 Curb	15
	5.6 NU1030, NU2035 and NU2540 Curb	15
6	<i>PERFORMANCE DATA – EFFECTIVENESS</i>	16
	6.1 NU0820 & NU1030	16
	6.1.1 HRV	16
	6.1.2 ERV	16
	6.2 NU0820 Face and Bypass	17
	6.2.1 HRV	17
	6.2.2 ERV	17
	NU1030 face and Bypass	17
	6.2.3 HRV	18
	6.2.4 ERV	18
	6.3 NU2035 & NU2540	19
	6.3.1 HRV	19
	6.3.2 ERV	19
	6.4 NU2035 & NU2540 Face and Bypass	20
	6.4.1 HRV	20
	6.4.2 ERV	20
7	<i>PERFORMANCE DATA – FANS & MOTORS</i>	21
	7.1 NU0820 HRV	21
	7.2 NU0820 HRV Face and Bypass	21
	7.3 NU0820 ERV	22
	7.4 NU0820 ERV Face and Bypass	22
	7.5 NU1030 HRV	23
	7.6 NU1030 HRV Face and Bypass	23
	7.7 NU1030 ERV	24

7.8	NU1030 ERV Face and Bypass.....	24
7.9	NU2035 HRV.....	25
7.10	NU2035 HRV Face and Bypass	25
7.11	NU2035 ERV	26
7.12	NU2035 ERV Face and Bypass.....	26
7.13	NU2540 HRV.....	27
7.14	NU2540 HRV Face and Bypass	27
7.15	NU2540 ERV	28
7.16	NU2540 ERV Face and Bypass.....	28
8	<i>ELECTRICAL Data</i>	29
8.1	Motors – all units	29
8.2	Electrical Schematics.....	29
9	<i>Installation</i>	40
9.1	Remote Control.....	40
9.1.1	INSTALLATION INSTRUCTIONS.....	40
9.2	Installation Basics	40
9.3	Mounting The Unit (Roof Top Units)	40
9.4	Connecting the Condensate Drain.....	42
9.5	Connecting To Other Equipment.....	42
9.6	Controls And Electrical Connection	43
9.7	Balancing The System	43
9.8	COMMISSIONING AND START UP - COMPLIANT SERIES	44
10	<i>MAINTENANCE</i>	46
a.	FILTERS	46
b.	FANS.....	46
c.	MOTORS.....	46
d.	BELTS	46
e.	CONDENSATE DRAIN	46
f.	CORE.....	46
g.	EXTERIOR HOODS.....	47
11	<i>WARRANTY:</i>	48

1 ABOUT THE H/ERV

The heat recovery ventilator (HRV) provides fresh air to a conditioned space while exhausting an equal amount of stale air. Heat energy is transferred from one air stream to the other within a non-contact cross flow heat exchanger. ERV models transfer latent energy (moisture) from the higher to lower air stream.

- A. Two fan motor sets deliver fresh air into the space and exhaust stale air from the space.
- B. Incoming fresh air is filtered before flowing through the heat exchange core.
- C. Stale air flows through the cross-flow heat exchanger and transfers the heat (HRV) (and moisture (ERV)) to the incoming fresh air.
- D. Warm fresh air is distributed through an independent ductwork system or an existing air distribution system.


2 PRODUCT SELECTION – OPTIONS BY PRODUCT

Unit Options		NU0820	NU2035	NU1030	NU2540
Capacity (cfm range)		800 -2000	2000 -4000	1000-3000	2000 -4000
Location	Indoor	O	S	O	O
	Outdoor	O	O	S	S
Defrost	None	S	S	S	S
	Exhaust Only (temp. on/off)	\$\$	\$\$	\$\$	\$\$
	Timed Exhaust (temp. on/timed off)	\$\$	\$\$	\$\$	\$\$
	Recirculation	\$\$	\$\$	\$\$	\$\$
	Face and Bypass	\$\$	\$\$	\$\$	\$\$
	Face and Bypass with Economizer	\$\$	\$\$	\$\$	\$\$
Voltage and Speeds	230/1, 1 speed	O	O	O	O
	208/3, 1 speed	O	O	O	O
	460/3, 1 speed	O	O	O	O
	575/3, 1 speed	O	O	O	O
Motor Options HP		.5, .75, 1, 1.5	.5, .75, 1, 1.5, 2, 3	.5, .75, 1, 1.5, 2, 3	.5, .75, 1, 1.5, 2, 3
Core	Sensible	S	S	S	S
	Enthalpy	\$\$	\$\$	\$\$	\$\$
Cabinet Finish	Galvanized Steel	S	S	S	S
	Painted Aluminum (white)	\$\$	\$\$	\$\$	\$\$
Supply Air Dampers	None	S	S	S	S
	Motorized	\$\$	\$\$	\$\$	\$\$
Exhaust Air Dampers	None	S	S	S	S
	Gravity	\$\$	\$\$	\$\$	\$\$
	Motorized	\$\$	\$\$	\$\$	\$\$
Supply Air Discharge	Horizontal (end)	S	S	S	S
	Vertical (down)	O	O	O	O
Return Air Intake	Horizontal (end)	S	S	S	S
	Vertical (down)	O	O	O	O
Filters	MERV 8	S	S	S	S
	MERV 13	\$\$	\$\$	\$\$	\$\$
ACCESSORIES					
VFD		\$\$	\$\$	\$\$	\$\$
Dirty Filter contacts		\$\$	\$\$	\$\$	\$\$
Aux. Contacts interlock		S	S	S	S
Roof Curb 14, 18, 22"	(Accessory, Consult Nu-Air)	\$\$	\$\$	\$\$	\$\$


Refer to *Performance Data* section of this document for fan/motor selections.

3 NOMENCLATURE, UNIT CONFIGURATIONS, FROST CONTROL

3.1 Nomenclature – Fishbone Chart

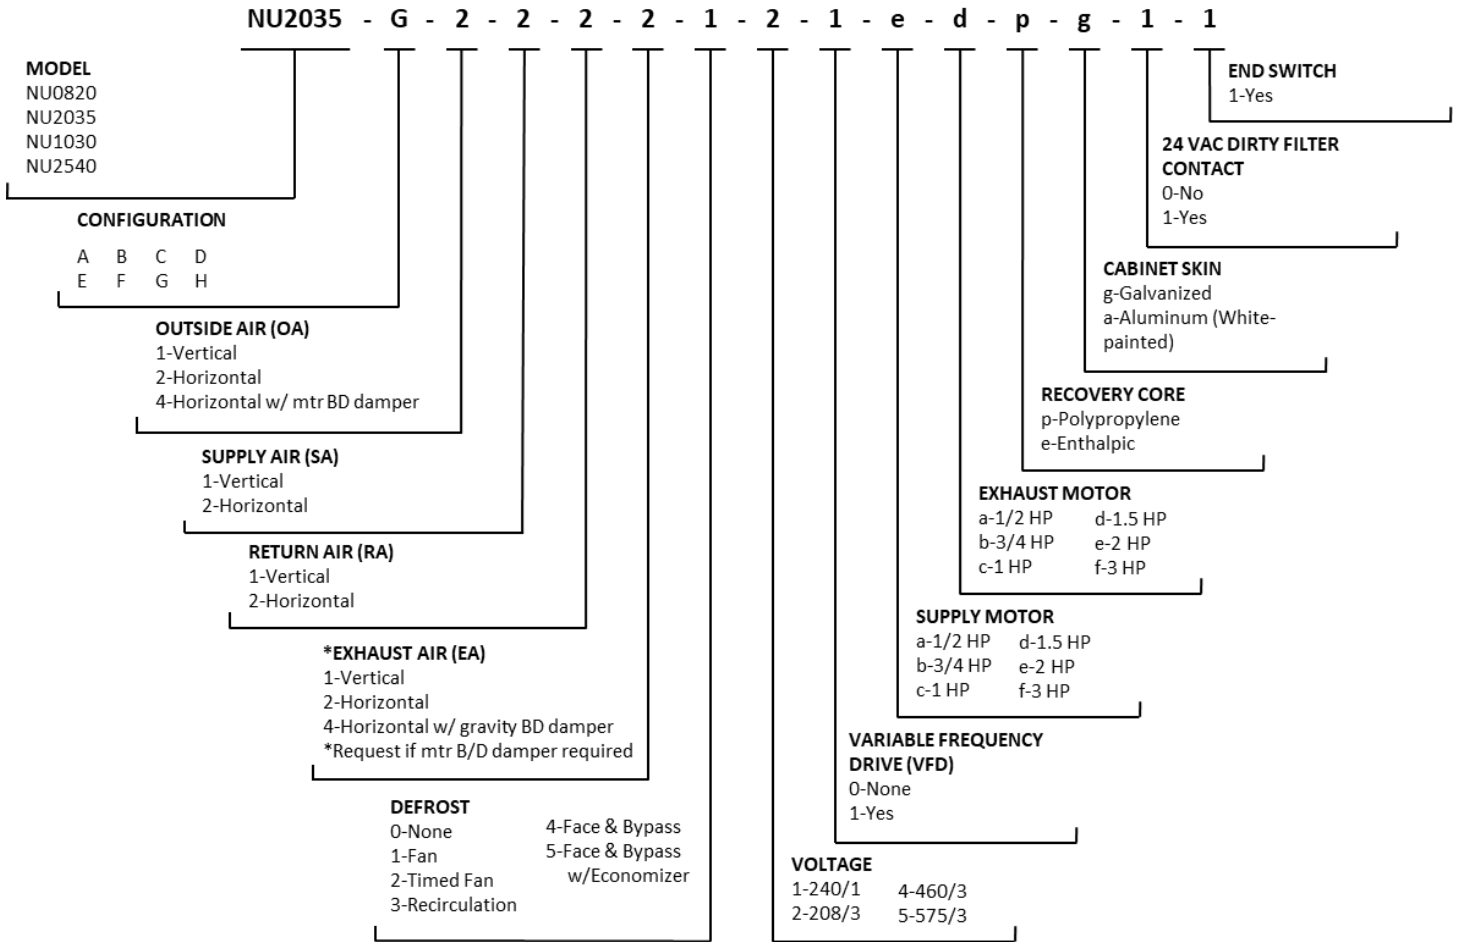

3.2 Unit (duct) Configurations

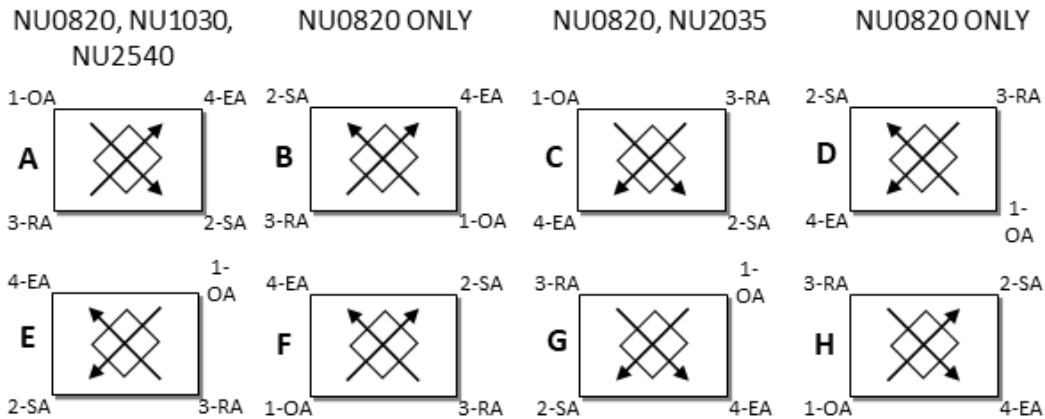

3.3 Defrost Recommendations

TYPE	WINTER DESIGN TEMP.		FACTORY DEFAULT TIMING**	
	° C	° F	RUN	DEFROST
0 – NONE	> -5	> 23	n/a	n/a
1 – FAN SHUT-DOWN	> -10	> 14		
2 – TIMED FAN SHUT-DOWN	> -15	> 5	60 min.	10 min.
3 – RECIRCULATION	> -15	> 5	60 min.	10 min.
4 – FACE & BYPASS	Uninterrupted ventilation and free cooling.			

NOTE: defrost recommendations notwithstanding other design considerations such as building pressure, preheat, delivered air temp., etc.

**Field adjustable.

1 – Supply fan shuts off when EA 0C (32F). Normal operation resumes when EA is 8C (47F).

2 – Supply fan shuts off for defined time when OA is nominal 0C (32F).

3 – Non-negative pressure defrost when EA is nominal 0C (32F).

4 – Heat exchanger bypassed in a temperature activated cycle.

4 SAMPLE SPECIFICATION

GENERAL

System Description:

Packaged Heat (Energy) Recovery Ventilator capable of transferring sensible (sensible and latent) energy designed to be used as a standalone ventilation system or as part of an engineered HVAC system with flat plate, cross flow heat exchanger integral to the unit.

Quality Assurance

Unit shall be constructed to CSA C22.2 standards and carry the mark label of an approved certifying body. Unit shall undergo 100% functionality testing at the factory prior to shipping and be accompanied with a **Compliance Certificate**. Unit shall be **factory balanced to project-specified air flow and static pressure**. Heat exchangers shall be certified and currently listed AHRI and shall meet UL 94 flame spread and smoke generation requirements.

Storage and Handling

Unit shall not be used during construction. Unit shall be stored and handled according to the manufacturer's instructions.

Warranty

Unit shall have a 2 year warranty on all parts except the core which has a 15 year warranty (polypropylene) or 5 year warranty (enthalpy).

EQUIPMENT

Construction

The cabinet shall be double wall construction. 22 Ga. galvanized steel inner wall and 22 Ga. galvanized steel (optional 0.050 painted white aluminum) outer wall. The unit shall be insulated with 1" R6 expanded polystyrene. All serviceable components shall be accessible through a hinged front access panel. Main service door will be removable and secured with a lockable quarter-turn handle. The heat exchanger core shall be easily removable for servicing.

Blowers

Blowers shall be FC DWDI, dynamically balanced and operate at not more than 1500 rpm. Internal vibration isolation is not required. Blower housing shall be galvanized steel.

Motors

Motors shall be continuous duty, permanently lubricated with a service factor of 1.15, matched to the fan load and required voltage and phase. Motors enclosure shall be Totally Enclosed.

Electrical requirements

The unit shall have a single point power connection within a NEMA4 enclosure with integral non-fused disconnect switch.. The unit shall be c/w 24 VAC control transformer with 200 VA for internal and remote controls.

Filtration

Unit shall come complete with 2” thick MERV 8 filters (standard).

Unit shall come complete with 2” thick MERV 13 filters (optional).

Heat exchanger

Polypropylene core constructed of flame retardant material and certified and currently listed with AHRI to Standard 1060.

Enthalpy core shall be constructed of a membrane treated to resist mold and odor causing bacteria, have latent energy transfer properties, flame retardancy, and be certified and currently listed with AHRI to Standard 1060.

Defrost

1. None - the unit may be ordered without defrost ability
2. Exhaust only defrost – a temperature sensor shuts down the supply fan when the leaving exhaust air is cold enough to freeze condensate. The supply fan remains off until the leaving exhaust air has reached +8C (47 F). The defrost sensor will allow some field adjustment of the initiation temperature.
3. Timed fan defrost – a temperature sensor shuts down the supply fan when the outside air is cold enough to freeze condensate. The supply fan remains off for a set length of time. The supply fan resumes normal operation for a set length of time and the cycle repeats as long as the outside air temperature is below the set point. Both defrost and run cycles shall be field adjustable via the unit's control.
4. Recirculation Defrost – a temperature sensor initiates defrost when outside air is cold enough to freeze condensate. The exhaust fan shuts down, the recirculation damper opens, the gravity and motorized back draft dampers close. The defrost cycle occurs for a field selectable length of time followed by a field selectable time of normal operation. The cycle repeats as long as the outside air temperature warrants.
5. Face and by Pass – a temperature sensor initiates by pass mode when the leaving exhaust temperature is cold enough to freeze condensate. Heat recovery is interrupted and both fans continue to run. Heat recovery mode resumes when the leaving exhaust temperature is above +8C (47 F).
6. Economizer – Economizer controls are integrated with the face and by pass damper. Temperature sensors in the RA and OA communicate with an adjustable temperature sensing relay to enable free cooling when the conditions are suitable.

Variable frequency drive

No. Unit comes with motor starters.

Yes. Factory shall supply VFD for each motor.

Cabinet

22 Ga. Galvanized Steel

0.050 pre-painted white aluminum

Dirty filter contact

Yes – 2 pressure switches with the unit.

No – pressure switches not supplied.

End switch


An auxiliary contact from each motor starter shall be provided. This contact is shipped dry but can be made 24VAC by moving a jumper.

Roof Curb

A 14" roof curb shall be supplied by the equipment manufacturer.

5 DIMENSIONAL DATA, CLEARANCES

5.1 NU0820

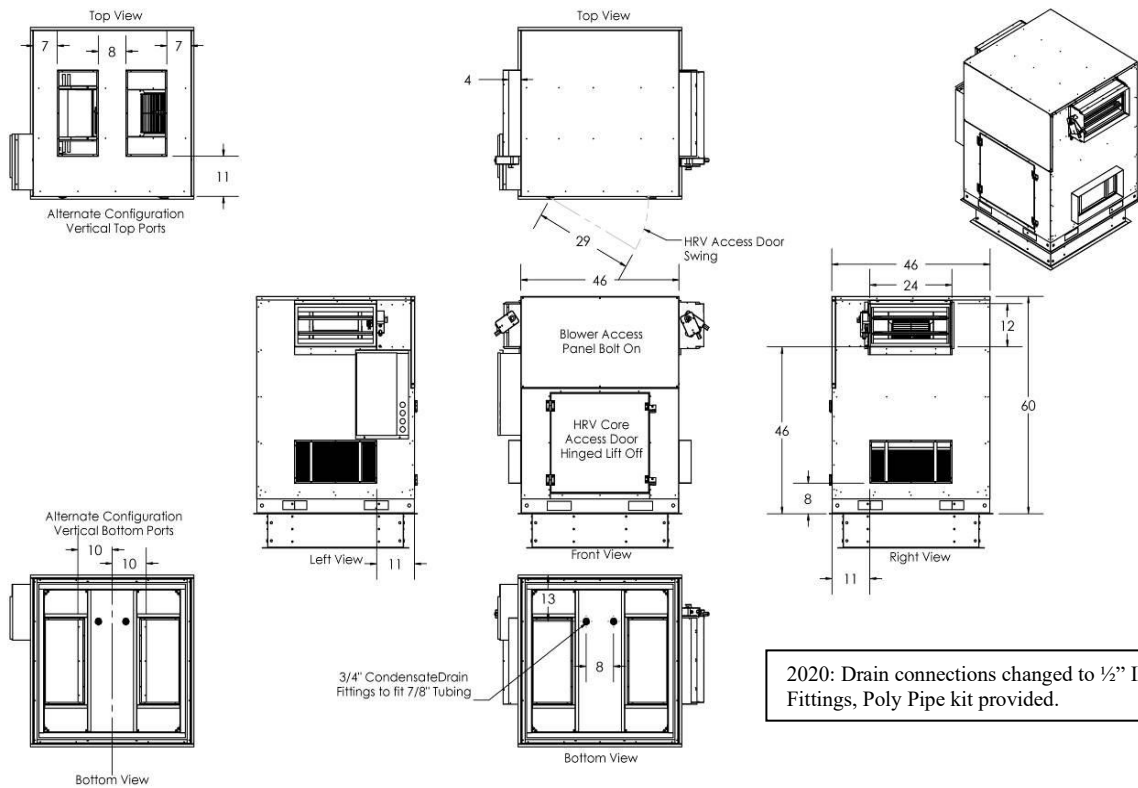


Dimensions shown are applicable to all variations of Heat Recovery Ventilator unless otherwise noted

Service Clearances: NU0820						
Front		Back	Left	Right	Top	Bottom
RECOMMENDED	MINIMUM					
(in)	(in)	(in)	(in)	(in)	(in)	(in)
30	24	0	*21	*21	0	0


*Allows for starter box access according to orientation/placement of unit.

5.2 NU1030

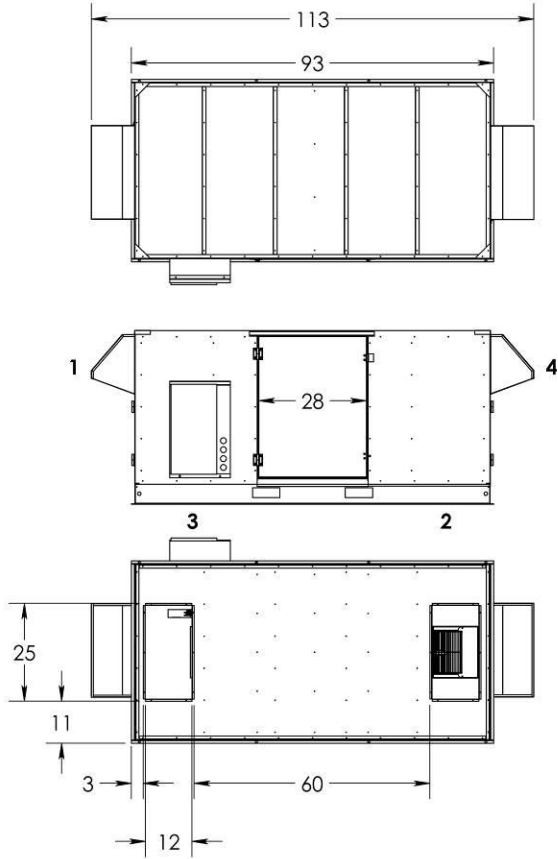


Air Stream	Designation	Location	
Standard Door Location			
Outside Air (OA)	1	Side	None
Supply Air (SA)	2	Bottom	Side
Return Air (RA)	3	Bottom	Side*
Exhaust Air (EA)	4	Side	None
Reverse Door Location			
Outside Air (OA)	4	Side	None
Supply Air (SA)	3	Bottom	Side
Return Air (RA)	2	Bottom	Side*
Exhaust Air (EA)	1	Side	None

* When side port, OA hood must be field relocated to a minimum of 36" above nearest horizontal surface to avoid snow or rain entering or blocking the hood.

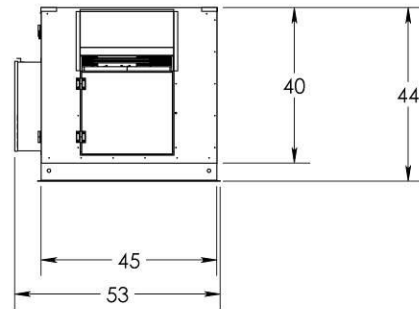


Service Clearances: NU1030						
Front	Back	Left	Right	Top	Bottom	
RECOMMENDED	MINIMUM					
(in)	(in)	(in)	(in)	(in)	(in)	(in)
30	24	0	0	0	0	0

5.3 NU2035

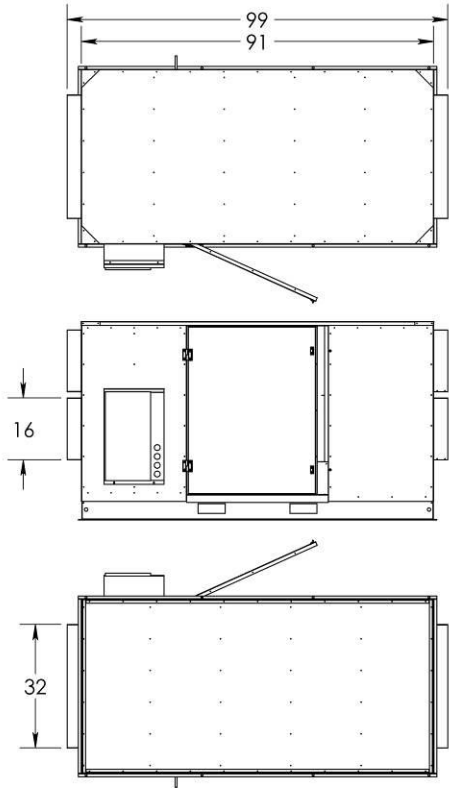


Air Stream	Designation	Location	
Standard Door Location		Standard	Option
Outside Air (OA)	1	Side	None
Supply Air (SA)	2	Bottom	Side
Return Air (RA)	3	Bottom	Side*
Exhaust Air (EA)	4	Side	None
Reverse Door Location			
Outside Air (OA)	4	Side	None
Supply Air (SA)	3	Bottom	Side
Return Air (RA)	2	Bottom	Side*
Exhaust Air (EA)	1	Side	None

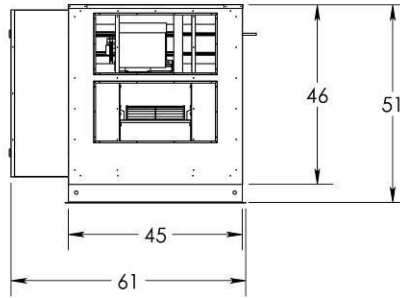


Service Clearances: NU2035						
Front		Back	Left	Right	Top	Bottom
RECOMMENDED	MINIMUM					
(in)	(in)	(in)	(in)	(in)	(in)	(in)
30	18	0	0	0	0	0

5.4 NU2540

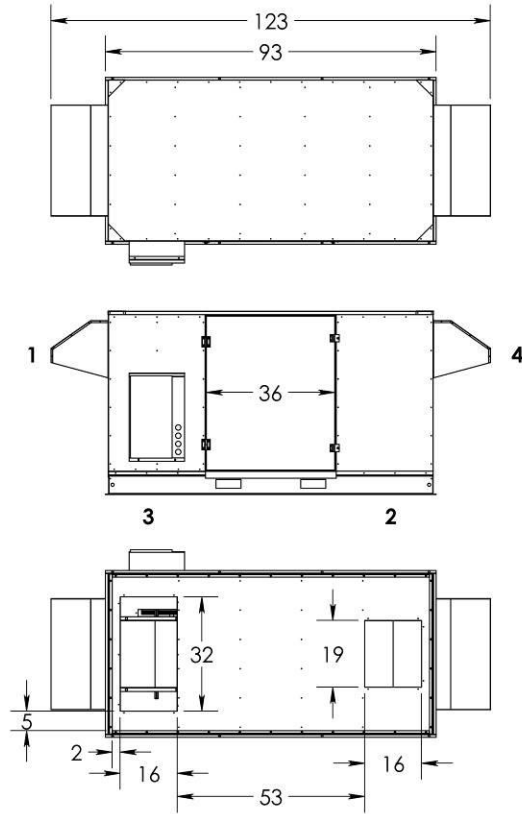


Air Stream	Designation	Location	
Standard Door Location			
Outside Air (OA)	1	Side	None
Supply Air (SA)	2	Bottom	Side
Return Air (RA)	3	Bottom	Side*
Exhaust Air (EA)	4	Side	None
Reverse Door Location			
Outside Air (OA)	4	Side	None
Supply Air (SA)	3	Bottom	Side
Return Air (RA)	2	Bottom	Side*
Exhaust Air (EA)	1	Side	None

* When side port, OA hood must be field relocated to a minimum of 36" above nearest horizontal surface to avoid snow or rain entering or blocking the hood.

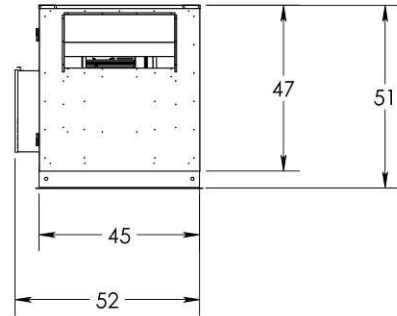


Service Clearances: NU2540						
Front		Back	Left	Right	Top	Bottom
RECOMMENDED	MINIMUM					
(in)	(in)	(in)	(in)	(in)	(in)	(in)
30	18	0	0	0	0	0

5.5 NU0820 Curb

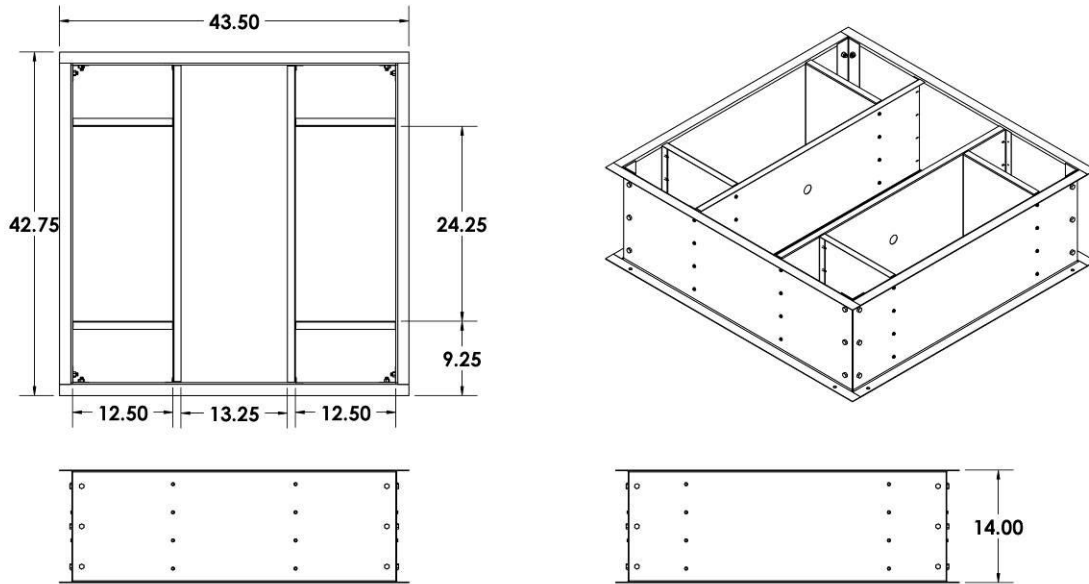


5.6 NU1030, NU2035 and NU2540 Curb

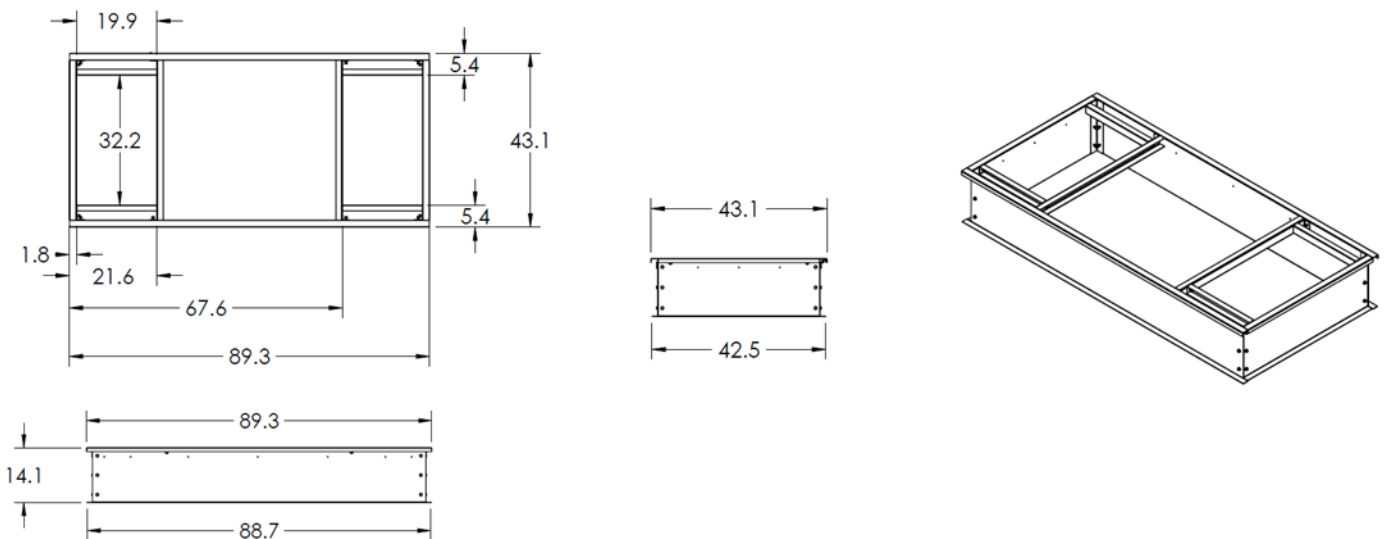

6 PERFORMANCE DATA – EFFECTIVENESS


6.1 NU0820 & NU1030

6.1.1 HRV

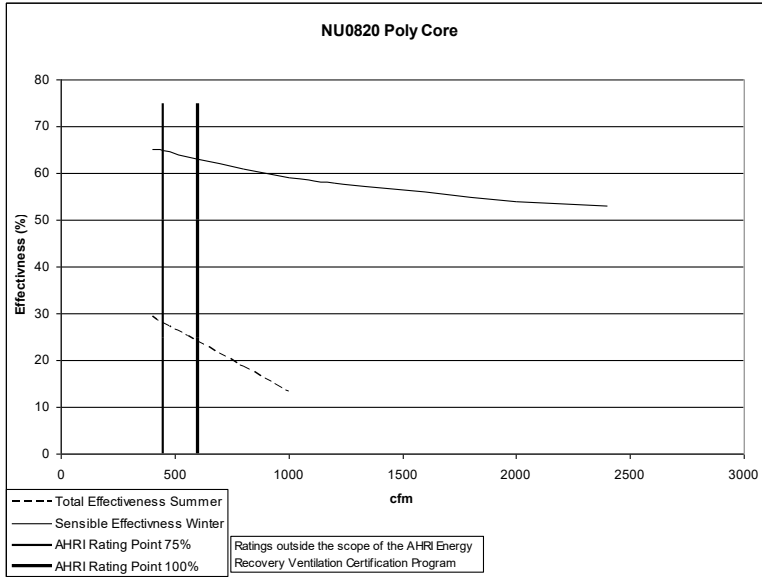

Model no.	PC 18		
Type	Plate		
Nominal Air Flow (scfm)	300		
Pressure drop (inches)	0.07		
Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	0.00	1.00
Test 2	0	0.00	1.00
Test 3	0.5	0.00	1.00
Thermal Effectiveness Ratings at 0" Pressure Differential			
	Sensible	Latent	Total
100% air Flow Heating	63	0	39
75% air Flow Heating	65	0	43
100% air Flow cooling	67	0	24
75% air Flow Cooling	71	0	28
	Net Sensible	Net Latent	Net Total
100% air Flow Heating	63	0	39
75% air Flow Heating	65	0	43
100% air Flow cooling	67	0	24
75% air Flow Cooling	71	0	28

6.1.2 ERV

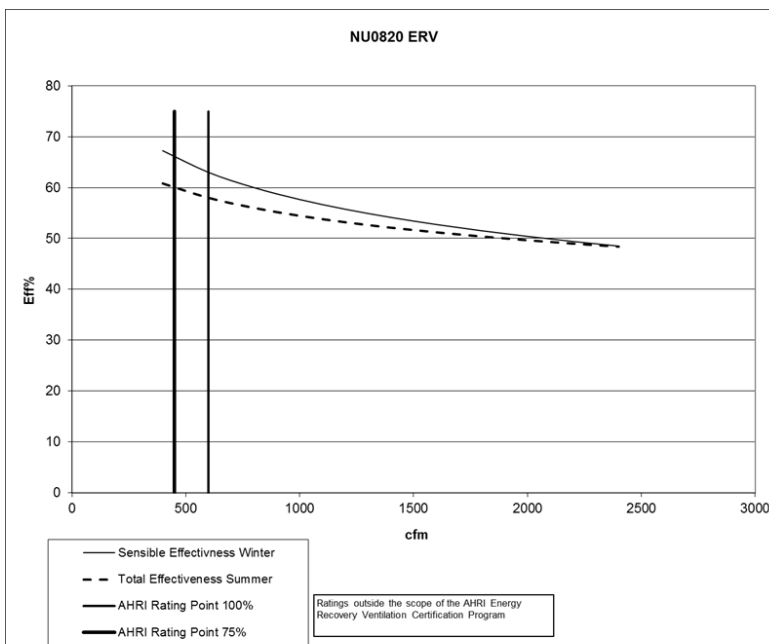


Model no.	EC-18		
Type	Plate		
Nominal Air Flow (scfm)	300		
Pressure drop (inches)	0.33		
Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	5.00	0.92
Test 2	0	0.80	1.07
Test 3	0.5	0.50	1.20
Thermal Effectiveness Ratings at 0" Pressure Differential			
	Sensible	Latent	Total
100% air Flow Heating	63	47	58
75% air Flow Heating	66	49	60
100% air Flow cooling	63	36	46
75% air Flow Cooling	66	39	49
	Net Sensible	Net Latent	Net Total
100% air Flow Heating	63	47	57
75% air Flow Heating	66	49	60
100% air Flow cooling	63	35	46
75% air Flow Cooling	66	39	49



Energy recovery component is certified by AHRI to AHRI Standard 1060. Actual performance in packaged equipment may vary.

6.2 NU0820 Face and Bypass


6.2.1 HRV

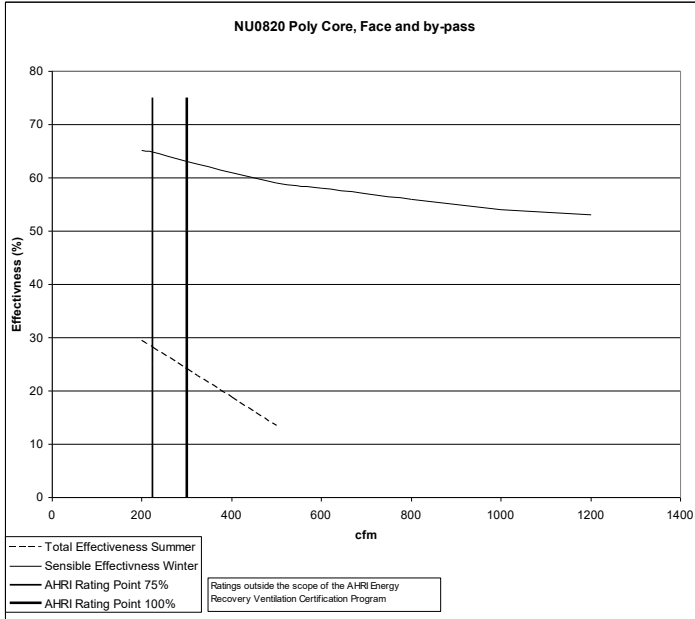

Model no.	PC 18		
Type	Plate		
Nominal Air Flow (scfm)	300		
Pressure drop (inches)	0.07		
Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	0.00	1.00
Test 2	0	0.00	1.00
Test 3	0.5	0.00	1.00
Thermal Effectiveness Ratings at 0" Pressure Differential			
	Sensible	Latent	Total
100% air Flow Heating	63	0	39
75% air Flow Heating	65	0	43
100% air Flow cooling	67	0	24
75% air Flow Cooling	71	0	28
	Net Sensible	Net Latent	Net Total
100% air Flow Heating	63	0	39
75% air Flow Heating	65	0	43
100% air Flow cooling	67	0	24
75% air Flow Cooling	71	0	28



6.2.2 ERV

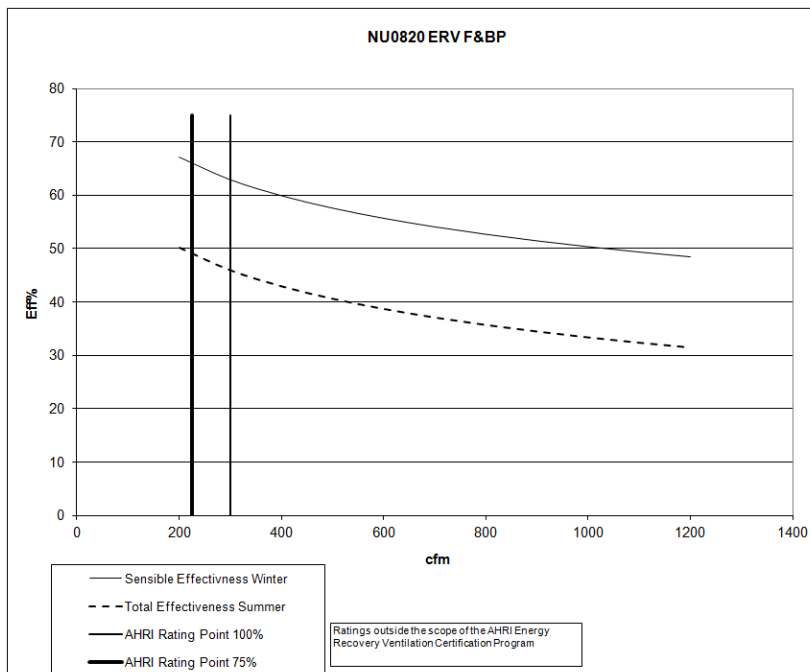

Model no.	EC-18
Type	Plate
Nominal Air Flow (scfm)	300
Pressure drop (inches)	0.33

Leakage Ratings	Diff. Pressure	EATR %	OACF
Test 1	-0.5	5	0.92
Test 2	0	0.8	1.07
Test 3	0.5	0.5	1.2

Thermal Effectiveness Ratings at 0" Pressure Differential

	Sensible	Latent	Total
100% air Flow Heating	63	47	58
75% air Flow Heating	66	49	60
100% air Flow cooling	63	36	46
75% air Flow Cooling	66	39	49


	Net Sensible	Net Latent	Net Total
100% air Flow Heating	63	47	57
75% air Flow Heating	66	49	60
100% air Flow cooling	63	35	46
75% air Flow Cooling	66	39	49



Energy recovery component is certified by AHRI to AHRI Standard 1060. Actual performance in packaged equipment may vary.


NU1030 face and Bypass

6.2.3 HRV

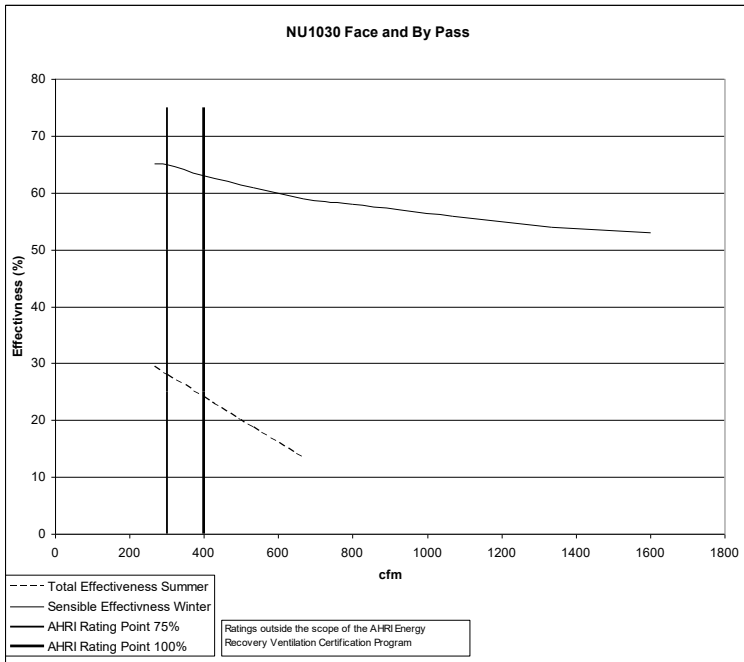

Model no.	PC 18		
Type	Plate		
Nominal Air Flow (scfm)	300		
Pressure drop (inches)	0.07		
Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	0.00	1.00
Test 2	0	0.00	1.00
Test 3	0.5	0.00	1.00
Thermal Effectiveness Ratings at 0" Pressure Differential			
	Sensible	Latent	Total
100% air Flow Heating	63	0	39
75% air Flow Heating	65	0	43
100% air Flow cooling	67	0	24
75% air Flow Cooling	71	0	28
	Net Sensible	Net Latent	Net Total
100% air Flow Heating	63	0	39
75% air Flow Heating	65	0	43
100% air Flow cooling	67	0	24
75% air Flow Cooling	71	0	28

6.2.4 ERV

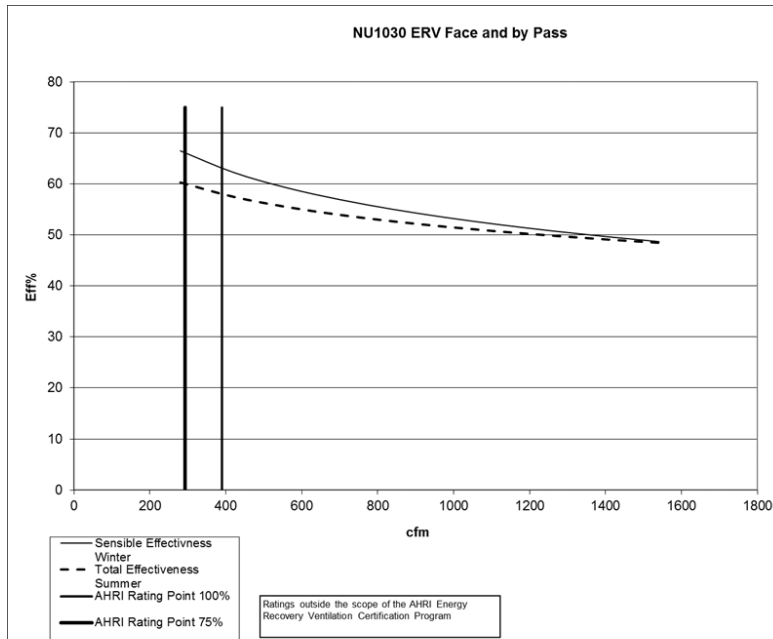


Model no.	EC-18		
Type	Plate		
Nominal Air Flow (scfm)	300		
Pressure drop (inches)	0.33		
Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	5.00	0.92
Test 2	0	0.80	1.07
Test 3	0.5	0.50	1.20
Thermal Effectiveness Ratings at 0" Pressure Differential			
	Sensible	Latent	Total
100% air Flow Heating	63	47	58
75% air Flow Heating	66	49	60
100% air Flow cooling	63	36	46
75% air Flow Cooling	66	39	49
	Net Sensible	Net Latent	Net Total
100% air Flow Heating	63	47	57
75% air Flow Heating	66	49	60
100% air Flow cooling	63	35	46
75% air Flow Cooling	66	39	49



Energy recovery component is certified by AHRI to AHRI Standard 1060. Actual performance in packaged equipment may vary.

6.3 NU2035 & NU2540

6.3.1 HRV

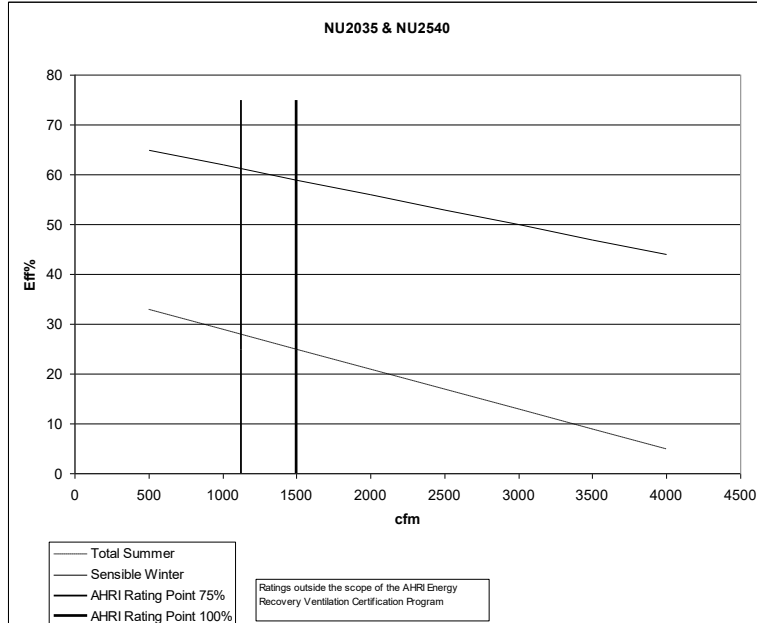


Model no.	PC 24		
Type	Plate		
Nominal Air Flow (scfm)	500		
Pressure drop (inches)	0.18		
Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	0.00	1.00
Test 2	0	0.00	1.00
Test 3	0.5	0.00	1.00

Thermal Effectiveness Ratings at 0" Pressure Differential			
	Sensible	Latent	Total
100% air Flow Heating	59	0	38
75% air Flow Heating	62	0	42
100% air Flow cooling	60	0	25
75% air Flow Cooling	65	0	28
	Net Sensible	Net Latent	Net Total
100% air Flow Heating	59	0	38
75% air Flow Heating	62	0	42
100% air Flow cooling	60	0	25
75% air Flow Cooling	65	0	28



6.3.2 ERV

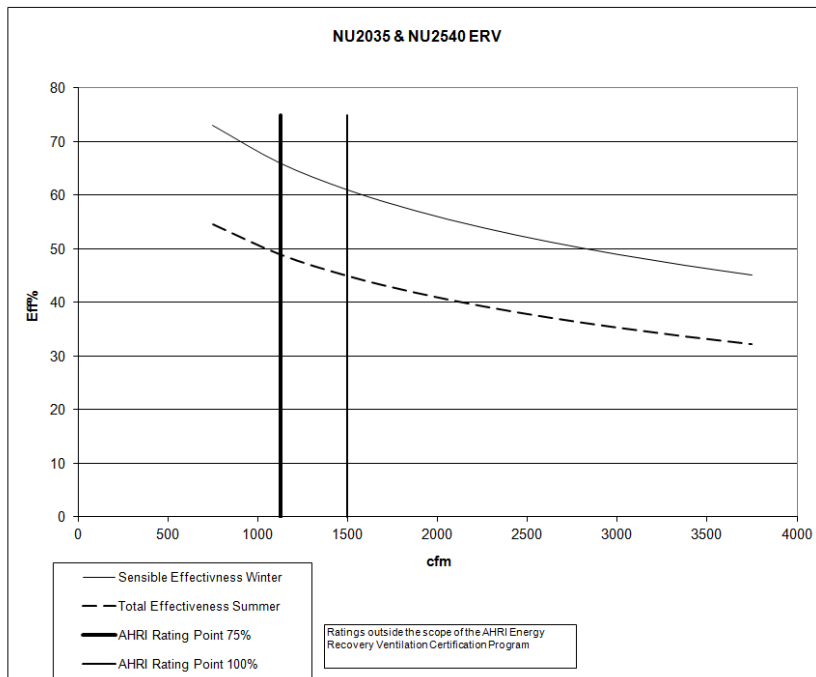

Model no.	EC-24
Type	Plate
Nominal Air Flow (scfm)	500
Pressure drop (inches)	0.23

Leakage Ratings	Diff. Pressure	EATR %	OACF
Test 1	-0.5	5	0.92
Test 2	0	0.8	1.07
Test 3	0.5	0.5	1.2

Thermal Effectiveness Ratings at 0" Pressure Differential

	Sensible	Latent	Total
100% air Flow Heating	61	46	56
75% air Flow Heating	66	49	60
100% air Flow cooling	61	35	45
75% air Flow Cooling	66	39	49


	Net Sensible	Net Latent	Net Total
100% air Flow Heating	61	46	56
75% air Flow Heating	66	49	60
100% air Flow cooling	61	34	44
75% air Flow Cooling	66	39	49



Energy recovery component is certified by AHRI to AHRI Standard 1060. Actual performance in packaged equipment may vary.

6.4 NU2035 & NU2540 Face and Bypass


6.4.1 HRV

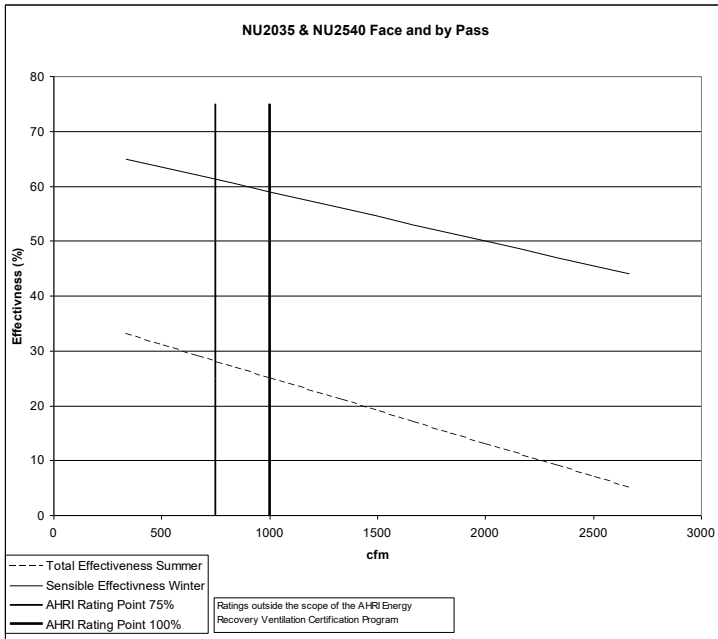

Model no.	PC 24		
Type	Plate		
Nominal Air Flow (scfm)	500		
Pressure drop (inches)	0.18		
Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	0.00	1.00
Test 2	0	0.00	1.00
Test 3	0.5	0.00	1.00
Thermal Effectiveness Ratings at 0" Pressure Differential			
	Sensible	Latent	Total
100% air Flow Heating	59	0	38
75% air Flow Heating	62	0	42
100% air Flow cooling	60	0	25
75% air Flow Cooling	65	0	28
	Net Sensible	Net Latent	Net Total
100% air Flow Heating	59	0	38
75% air Flow Heating	62	0	42
100% air Flow cooling	60	0	25
75% air Flow Cooling	65	0	28



6.4.2 ERV

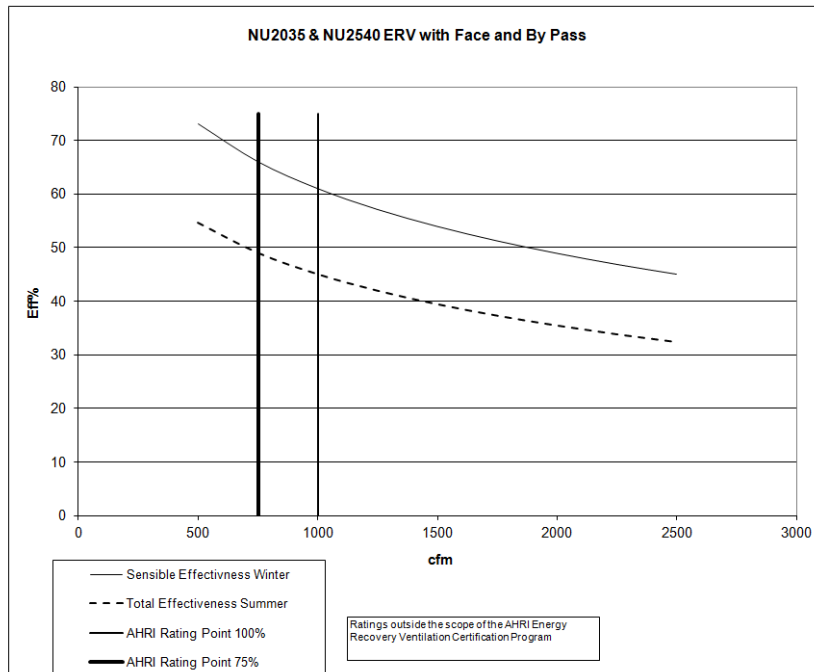

Model no.	EC-24
Type	Plate
Nominal Air Flow (scfm)	500
Pressure drop (inches)	0.23

Leakage Ratings			
	Diff. Pressure	EATR %	OACF
Test 1	-0.5	5	0.92
Test 2	0	0.8	1.07
Test 3	0.5	0.5	1.2

Thermal Effectiveness Ratings at 0" Pressure Differential

	Sensible	Latent	Total
100% air Flow Heating	61	46	56
75% air Flow Heating	66	49	60
100% air Flow cooling	61	35	45
75% air Flow Cooling	66	39	49

	Net Sensible	Net Latent	Net Total
100% air Flow Heating	61	46	56
75% air Flow Heating	66	49	60
100% air Flow cooling	61	34	44
75% air Flow Cooling	66	39	49



Energy recovery component is certified by AHRI to AHRI Standard 1060. Actual performance in packaged equipment may vary.

7 PERFORMANCE DATA – FANS & MOTORS

7.1 NU0820 HRV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
800	1/2 HP	0.16	723	0.23	879	0.32	1006	0.41	1115	0.5	1209	0.59	1295	3/4 HP	800
900		0.19	758	0.28	909	0.37	1035	0.47	1145	0.57	1242	0.67	1327		900
1000		0.23	796	0.33	943	0.43	1067	0.53	1175	0.64	1273	0.75	1361		1000
1100		0.27	826	0.37	969	0.48	1091	0.6	1199	0.71	1296	0.83	1385	1 HP	1100
1200		0.32	860	0.43	998	0.55	1118	0.67	1225	0.79	1322	0.92	2.06		1200
1300		0.37	886	0.49	1021	0.61	1139	0.74	1245	0.87	1342	1	1431		1300
1400		0.43	917	0.55	1047	0.68	1163	0.82	1268	0.96	1364	1.1	1452	1.5 HP	1400
1500		0.48	942	0.62	1067	0.75	1181	0.9	1285	1.04	1381	1.19	1469		1500
1600	3/4 HP	0.55	971	0.69	1092	0.83	1203	0.98	1306	1.14	1400	1.29	1488		1600
1700		0.62	1000	0.77	1116	0.92	1224	1.07	1325	1.23	1418	1.4	1506		1700
1800	0.7	1027	0.84	1135	1	1240	1.16	1340	1.33	1432	1.5	1519	1800		
1900	1 HP	0.78	1057	0.93	1158	1.09	1260	1.26	1357	1.44	1449			N/A	1900
2000		0.87	1083	1.02	1177	1.18	1276	1.36	1371						2000

7.2 NU0820 HRV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
800	1/2 HP	0.22	850	0.3	983	0.39	1095	0.48	1191	0.57	1278	0.67	1359	3/4 HP	800
900		0.27	898	0.36	1026	0.46	1137	0.56	1234	0.66	1320	0.76	1400		900
1000		0.32	937	0.42	1062	0.53	1171	0.64	1269	0.75	1358	0.86	1437	1 HP	1000
1100		0.38	979	0.49	1100	0.61	1207	0.72	1304	0.84	1392	0.96	1474		1100
1200		0.45	1018	0.57	1136	0.69	1241	0.81	1337	0.94	1424	1.07	1506		1200
1300	3/4 HP	0.52	1055	0.65	1170	0.78	1273	0.91	1367	1.04	1454	1.18	1535	1.5 HP	1300
1400		0.6	1090	0.73	1202	0.87	1303	1.01	1396	1.15	1483	1.3	1563		1400
1500		0.68	1123	0.82	1232	0.97	1332	1.11	1424	1.26	1509	1.42	1589		1500

7.3 NU0820 ERV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
800	1/2 HP	0.18	790	0.27	932	0.35	1052	0.44	1153	0.53	1244	0.63	1327	3/4 HP	800
900		0.23	835	0.32	972	0.42	1090	0.51	1193	0.61	1283	0.71	1366		900
1000		0.28	876	0.38	1010	0.48	1125	0.59	1227	0.7	1320	0.81	1402	1 HP	1000
1100		0.33	914	0.44	1044	0.55	1157	0.67	1259	0.78	1351	0.9	1436		1100
1200		0.39	951	0.51	1077	0.62	1188	0.75	1288	0.87	1379	1	1464		1200
1300		0.45	985	0.58	1107	0.7	1217	0.83	1316	0.97	1406	1.1	1491	1.5 HP	1300
1400		0.53	1022	0.66	1141	0.79	1248	0.93	1345	1.07	1435	1.22	1519		1400
1500	0.6	1053	0.74	1168	0.88	1273	1.03	1370	1.17	1459	1.33	1542	1500		
1600	3/4 HP	0.68	1083	0.82	1195	0.97	1298	1.12	1393	1.28	1481	1.44	1564	1600	
1700	1 HP	0.77	1116	0.92	1224	1.07	1325	1.23	1418	1.4	1506			N/A	1700
1800		0.86	1148	1.02	1253	1.18	1351	1.35	1443						1800
1900		0.96	1175	1.12	1276	1.29	1372	1.46	1463						1900
2000	1.5 HP	1.06	1205	1.23	1303	1.41	1397						2000		

7.4 NU0820 ERV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
800	1/2 HP	0.29	963	0.38	1078	0.46	1176	0.56	1265	0.65	1346	0.75	1422	3/4 HP	800
900		0.36	1021	0.45	1133	0.55	1231	0.65	1317	0.76	1397	0.86	1472	1 HP	900
1000		0.43	1076	0.54	1183	0.65	1280	0.76	1367	0.87	1446	0.98	1519		1000
1100	3/4 HP	0.52	1131	0.64	1235	0.75	1329	0.87	1416	1	1495	1.12	1567	1.5 HP	1100
1200		0.62	1184	0.74	1284	0.87	1376	1	1461	1.13	1540	1.26	1614		1200

7.5 NU1030 HRV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
1000	1/2 HP	0.24	822	0.34	964	0.44	1085	0.55	1192	0.66	1288	0.77	1374	1 HP	1000
1100		0.29	850	0.39	990	0.5	1109	0.61	1215	0.73	1311	0.85	1399		1100
1200		0.34	883	0.45	1018	0.57	1136	0.69	1241	0.81	1337	0.94	1424		1200
1300		0.39	909	0.51	1041	0.63	1157	0.76	1261	0.89	1356	1.03	1444	1 1/2 HP	1300
1400		0.44	934	0.57	1062	0.7	1176	0.84	1280	0.97	1375	1.12	1462		1400
1500		0.5	963	0.64	1086	0.78	1199	0.92	1301	1.07	1395	1.22	1483		1500
1600	3/4 HP	0.57	986	0.71	1106	0.85	1216	1	1317	1.16	1411	1.31	1498	2 HP	1600
1700		0.63	1009	0.78	1125	0.93	1233	1.09	1333	1.25	1426	1.41	1512		1700
1800		0.71	1039	0.86	1148	1.02	1253	1.18	1351	1.35	1443	1.52	1529		1800
1900	1 HP	0.8	1065	0.94	1166	1.11	1268	1.27	1365	1.45	1456	1.63	1542	3 HP	1900
2000		0.89	1095	1.04	1189	1.2	1288	1.38	1382	1.56	1472	1.74	1557		2000
2100		0.98	1120	1.13	1211	1.3	1304	1.48	1396	1.67	1484	1.86	1568		2100
2200	1 1/2 HP	1.08	1149	1.24	1237	1.41	1323	1.59	1413	1.75	1499	1.98	1582	3 HP	2200
2300		1.19	1174	1.35	1260	1.52	1341	1.71	1427	1.9	1511	2.11	1593		2300
2400		1.31	1202	1.47	1286	1.65	1365	1.83	1444	2.03	1527	2.24	1607		2400
2500		1.43	1230	1.6	1311	1.78	1389	1.97	1463	2.17	1542	2.38	1620		2500
2600	2 HP	1.55	1254	1.73	1333	1.91	1409	2.1	1482	2.3	1555	2.52	1631	N/A	2600
2700		1.69	1282	1.87	1359	2.06	1433	2.26	1504	2.46	1573	2.67	1645		2700
2800		1.84	1309	2.03	1384	2.22	1456	2.42	1526	2.62	1594	2.83	1660		2800
2900		1.98	1332	2.18	1406	2.37	1477	2.58	1545	2.78	1612	3	1676		2900
3000		3 HP	2.15	1359	2.34	1431	2.54	1500	2.75	1567	2.96	1632			3000

7.6 NU1030 HRV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
800	1/2 HP	0.19	802	0.27	943	0.36	1061	0.45	1161	0.54	1251	0.63	1334	3/4 HP	800
900		0.23	841	0.32	977	0.42	1094	0.52	1197	0.62	1287	0.72	1369		900
1000		0.28	876	0.38	1010	0.48	1125	0.59	1227	0.7	1320	0.81	1402		1000
1100		0.33	914	0.44	1044	0.55	1157	0.67	1259	0.78	1351	0.92	1445	1 HP	1100
1200		0.39	945	0.5	1072	0.62	1184	0.74	1284	0.87	1376	1	1461		1200
1300		0.44	974	0.57	1098	0.69	1208	0.82	1308	0.96	1399	1.09	1484		1300
1400	3/4 HP	0.51	1007	0.64	1127	0.78	1236	0.91	1334	1.05	1425	1.2	1509	1 1/2 HP	1400
1500		0.58	1038	0.72	1155	0.86	1261	1.01	1359	1.16	1449	1.31	1532		1500
1600		0.65	1064	0.8	1177	0.95	1282	1.1	1378	1.26	1468	1.41	1551		1600
1700		0.74	1093	0.89	1203	1.04	1305	1.2	1400	1.37	1489	1.53	1572		1700
1800	1 HP	0.82	1122	0.98	1228	1.14	1328	1.31	1421	1.48	1509	1.65	1591	2 HP	1800
1900		0.92	1149	1.08	1252	1.25	1350	1.42	1442	1.6	1528	1.78	1610		1900
2000	1 1/2 HP	1.02	1177	1.18	1276	1.36	1371	1.54	1461	1.72	1547	1.91	1628		2000

7.7 NU1030 ERV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
1000	1/2 HP	0.29	899	0.39	1029	0.5	1142	0.6	1243	0.72	1334	0.83	1415	1 HP	1000
1100		0.35	937	0.46	1063	0.57	1174	0.68	1274	0.8	1365	0.92	1449		1100
1200		0.41	972	0.52	1095	0.64	1205	0.77	1303	0.89	1393	1.02	1477		1200
1300		0.47	1005	0.6	1126	0.72	1233	0.85	1331	0.99	1420	1.13	1503		1300
1400	3/4 HP	0.54	1037	0.67	1154	0.81	1260	0.95	1357	1.09	1445	1.23	1528	1 1/2 HP	1400
1500		0.62	1067	0.75	1181	0.9	1285	1.04	1381	1.19	1469	1.34	1552		1500
1600		0.69	1097	0.84	1207	0.99	1310	1.14	1404	1.3	1491	1.46	1573		1600
1700	1 HP	0.78	1129	0.94	1237	1.09	1336	1.25	1429	1.42	1516	1.59	1597	2 HP	1700
1800		0.87	1156	1.03	1261	1.2	1359	1.36	1450	1.54	1536	1.71	1617		1800
1900		0.97	1187	1.14	1288	1.31	1384	1.48	1474	1.66	1558	1.85	1638		1900
2000	1 1/2 HP	1.08	1213	1.25	1311	1.42	1404	1.6	1493	1.79	1576	1.98	1656	3 HP	2000
2100		1.19	1243	1.36	1337	1.55	1428	1.73	1515	1.93	1597	2.12	1676		2100
2200		1.31	1274	1.49	1363	1.68	1451	1.87	1536	2.07	1617	2.27	1695		2200
2300		1.44	1303	1.61	1385	1.81	1471	2.01	1554	2.21	1634	2.42	1710		2300
2400	2 HP	1.58	1334	1.75	1411	1.95	1494	2.16	1575	2.37	1653	2.58	1729	N/A	2400
2500		1.72	1364	1.91	1440	2.1	1516	2.31	1596	2.53	1672	2.75	1746		2500
2600		1.88	1397	2.07	1471	2.27	1542	2.48	1619	2.7	1694	2.93	1767		2600
2700	3 HP	2.05	1427	2.24	1498	2.44	1568	2.65	1639	2.88	1713			N/A	2700
2800		2.22	1456	2.42	1526	2.62	1594	2.83	1660						2800
2900		2.4	1485	2.6	1553	2.81	1620								2900
3000		2.59	1516	2.8	1583										3000

7.8 NU1030 ERV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.5		Motor Size	CFM		
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM				
800	1/2 HP	0.24	884	0.32	1011	0.41	1119	0.5	1212	0.59	1298	0.69	1377	3/4 HP	800		
900		0.29	936	0.39	1059	0.49	1166	0.59	1259	0.69	1343	0.79	1421		1 HP	900	
1000		0.36	985	0.46	1103	0.57	1208	0.68	1302	0.79	1387	0.9	1464			1000	
1100		0.42	1025	0.53	1140	0.65	1243	0.76	1336	0.88	1422	1.01	1501			1 1/2 HP	1100
1200		0.5	1072	0.62	1184	0.74	1284	0.87	1376	1	1461	1.13	1540				1200
1300	3/4 HP	0.58	1112	0.71	1221	0.84	1319	0.97	1410	1.11	1494	1.25	1572	1 1/2 HP	1300		
1400		0.67	1150	0.8	1256	0.94	1353	1.08	1442	1.23	1525	1.37	1603		1400		
1500	1 HP	0.77	1190	0.91	1293	1.05	1388	1.2	1475	1.36	1558	1.51	1635	2 HP	1500		
1600		0.86	1224	1.01	1325	1.17	1418	1.33	1505	1.49	1586	1.65	1663		1600		
1700		0.97	1261	1.13	1359	1.29	1451	1.46	1536	1.63	1616	1.8	1692		1700		
1800	1 1/2 HP	1.09	1297	1.26	1392	1.43	1482	1.6	1565	1.77	1645	1.95	1720	3 HP	1800		
1900		1.21	1331	1.39	1424	1.56	1511	1.74	1594	1.93	1672	2.11	1746		1900		
2000		1.35	1368	1.53	1458	1.71	1543	1.9	1625	2.09	1702	2.29	1775		2000		

7.9 NU2035 HRV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP = 2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
2000	1/2 HP	0.29	544	0.41	656	0.54	753	0.66	838	0.78	914	0.90	982	1.01	1043	1.12	1099	1 1/2 HP	2000
2100		0.31	553	0.44	663	0.58	759	0.70	843	0.83	918	0.95	986	1.07	1047	1.19	1104		2100
2200		0.34	563	0.47	670	0.61	765	0.75	848	0.88	922	1.01	990	1.14	1052	1.26	1109		2200
2300		0.37	572	0.50	678	0.65	770	0.79	853	0.93	927	1.07	995	1.20	1056	1.33	1113		2300
2400		0.40	581	0.54	685	0.69	776	0.84	858	0.98	931	1.13	999	1.27	1061	1.41	1118		2400
2500		0.43	591	0.58	692	0.73	782	0.89	863	1.04	936	1.19	1003	1.33	1065	1.48	1122		2500
2600		0.46	600	0.62	699	0.78	788	0.94	868	1.09	940	1.25	1007	1.40	1069	1.56	1127		2600
2700	3/4 HP	0.50	609	0.66	707	0.82	794	0.99	872	1.15	945	1.31	1012	1.47	1074	1.63	1132	2 HP	2700
2800		0.54	618	0.70	714	0.87	800	1.04	877	1.21	949	1.38	1016	1.54	1078	1.71	1136		2800
2900		0.58	628	0.74	721	0.92	805	1.09	882	1.27	954	1.44	1020	1.62	1083	1.79	1141		2900
3000		0.62	637	0.79	729	0.97	811	1.15	887	1.33	958	1.51	1025	1.69	1087	1.87	1145		3000
3100		0.66	646	0.84	736	1.02	817	1.21	892	1.39	962	1.58	1029	1.77	1091	1.95	1150		3100
3200	0.71	656	0.89	743	1.08	823	1.27	897	1.46	967	1.65	1033	1.84	1096	2.03	1155	3200		
3300	1 HP	0.76	665	0.94	751	1.13	829	1.33	902	1.52	971	1.72	1038	1.92	1100	2.12	1159	3 HP	3300
3400		0.81	674	1.00	758	1.19	835	1.39	907	1.59	976	1.79	1042	2.00	1105	2.20	1164		3400
3500		0.86	684	1.05	765	1.25	841	1.45	912	1.66	980	1.87	1046	2.08	1109	2.29	1168		3500
3600		0.92	693	1.11	772	1.31	846	1.52	917	1.73	985	1.94	1050	2.16	1113	2.38	1173		3600
3700		0.98	702	1.17	780	1.37	852	1.58	922	1.80	989	2.02	1055	2.24	1118	2.47	1178		3700
3800	1 1/2 HP	1.04	711	1.23	787	1.44	858	1.65	927	1.87	994	2.10	1059	2.33	1122	2.56	1182	3800	
3900		1.10	721	1.29	794	1.50	864	1.72	932	1.94	998	2.18	1063	2.41	1127	2.65	1187	3900	
4000		1.16	730	1.36	802	1.57	870	1.79	937	2.02	1003	2.26	1068	2.50	1131	2.74	1191	4000	

7.10 NU2035 HRV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP = 2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
1600	1/2 HP	0.26	586	0.35	689	0.45	775	0.54	851	0.63	919	0.72	981	0.81	1039	0.90	1093	1 HP	1600
1700		0.29	597	0.39	699	0.49	784	0.59	860	0.69	928	0.78	990	0.88	1048	0.98	1102		1700
1800		0.32	608	0.42	709	0.54	794	0.64	869	0.74	937	0.85	999	0.95	1057	1.05	1112		1800
1900		0.35	619	0.46	718	0.58	803	0.69	879	0.80	946	0.91	1009	1.02	1067	1.13	1121		1900
2000		0.39	630	0.51	728	0.63	812	0.75	888	0.86	956	0.98	1018	1.10	1076	1.21	1130		2000
2100		0.42	641	0.55	738	0.68	822	0.80	897	0.92	965	1.05	1027	1.17	1085	1.29	1140		2100
2200		0.46	652	0.59	748	0.73	831	0.86	906	0.98	974	1.12	1036	1.25	1094	1.37	1149		2200
2300	3/4 HP	0.50	663	0.64	758	0.78	841	0.92	915	1.05	983	1.19	1045	1.33	1103	1.46	1158	2 HP	2300
2400		0.54	674	0.69	767	0.83	850	0.98	925	1.12	992	1.26	1055	1.41	1113	1.55	1167		2400
2500		0.58	685	0.74	777	0.89	859	1.04	934	1.18	1001	1.34	1064	1.49	1122	1.63	1177		2500
2600		0.63	696	0.79	787	0.95	869	1.10	943	1.25	1010	1.41	1073	1.57	1131	1.72	1186		2600
2700		0.68	707	0.84	797	1.00	878	1.17	952	1.33	1019	1.49	1082	1.66	1140	1.82	1195		2700
2800	0.73	718	0.90	807	1.06	887	1.23	961	1.40	1029	1.57	1091	1.74	1149	1.91	1205	2800		
2900	1 HP	0.78	729	0.95	816	1.13	897	1.30	971	1.47	1038	1.65	1101	1.83	1159	2.00	1214	3 HP	2900
3000		0.83	740	1.01	826	1.19	906	1.37	980	1.55	1047	1.73	1110	1.92	1168	2.10	1223		3000

7.11 NU2035 ERV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP = 2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
2000	1/2 HP	0.41	656	0.53	752	0.65	835	0.77	908	0.89	975	1.01	1037	1.12	1093	1.23	1147	1 1/2 HP	2000
2100		0.45	671	0.58	766	0.71	848	0.83	921	0.96	988	1.08	1049	1.20	1106	1.32	1159		2100
2200		0.49	681	0.62	776	0.76	857	0.89	930	1.02	997	1.15	1058	1.28	1115	1.41	1169		2200
2300	3/4 HP	0.53	691	0.67	785	0.81	866	0.95	939	1.09	1006	1.22	1067	1.36	1124	1.49	1178	2 HP	2300
2400		0.58	705	0.73	798	0.87	878	1.01	951	1.16	1017	1.30	1078	1.45	1135	1.59	1189		2400
2500		0.63	714	0.78	806	0.93	887	1.08	959	1.23	1025	1.38	1087	1.53	1144	1.68	1198		2500
2600		0.68	727	0.83	818	0.99	898	1.15	970	1.30	1036	1.46	1097	1.62	1154	1.77	1208		2600
2700		0.73	737	0.89	825	1.05	906	1.21	978	1.38	1044	1.54	1105	1.70	1162	1.86	1216	2700	
2800	1 HP	0.78	749	0.95	837	1.12	916	1.29	988	1.46	1054	1.63	1114	1.80	1172	1.96	1225	3 HP	2800
2900		0.84	759	1.01	844	1.18	923	1.36	995	1.53	1061	1.71	1122	1.88	1179	2.06	1233		2900
3000		0.90	771	1.08	855	1.26	933	1.44	1005	1.62	1070	1.80	1131	1.98	1188	2.16	1242		3000
3100		0.96	784	1.15	866	1.33	943	1.52	1014	1.71	1080	1.89	1140	2.08	1197	2.27	1251		3100
3200	1 1/2 HP	1.03	796	1.22	876	1.41	952	1.60	1023	1.80	1089	1.99	1149	2.18	1206	2.37	1259	3 HP	3200
3300		1.09	806	1.28	884	1.48	959	1.68	1029	1.88	1095	2.08	1155	2.28	1212	2.48	1266		3300
3400		1.16	819	1.36	894	1.56	968	1.77	1037	1.97	1103	2.18	1164	2.38	1220	2.59	1274		3400
3500		1.23	832	1.44	905	1.65	977	1.86	1046	2.07	1111	2.28	1172	2.49	1228	2.70	1282		3500
3600		1.31	845	1.52	916	1.74	986	1.95	1054	2.17	1119	2.38	1179	2.60	1236	2.82	1290		3600
3700		1.39	858	1.60	926	1.82	996	2.05	1062	2.27	1126	2.49	1187	2.71	1.23	2.94	1297		3700
3800		1.47	871	1.69	937	1.92	1005	2.14	1071	2.37	1134	2.60	1194	2.83	1251				3800
3900	2 HP	1.56	884	1.78	948	2.01	1014	2.24	1079	2.48	1141	2.71	1201	2.95	1258			3900	
4000		1.65	897	1.87	960	2.11	1023	2.35	1087	2.59	1149	2.83	1208					4000	

7.12 NU2035 ERV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP = 2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
1600	1/2 HP	0.38	711	0.47	795	0.56	868	0.65	934	0.74	995	0.83	1052	0.92	1106	1.02	1156	1 1/2 HP	1600
1700		0.43	729	0.52	812	0.62	884	0.72	950	0.81	1010	0.91	1067	1.00	1121	1.11	1171		1700
1800		0.47	747	0.57	829	0.68	900	0.79	965	0.89	1026	0.99	1082	1.09	1136	1.20	1185		1800
1900	3/4 HP	0.53	765	0.63	846	0.75	917	0.86	981	0.97	1041	1.08	1097	1.18	1150	1.29	1200	2 HP	1900
2000		0.58	783	0.69	863	0.81	933	0.93	997	1.05	1056	1.16	1112	1.28	1165	1.39	1214		2000
2100		0.64	801	0.76	880	0.89	949	1.01	1012	1.14	1072	1.26	1127	1.37	1180	1.49	1229		2100
2200		0.70	819	0.83	897	0.96	965	1.09	1028	1.23	1087	1.35	1142	1.48	1195	1.60	1243		2200
2300	1 HP	0.77	837	0.90	914	1.04	981	1.18	1044	1.32	1103	1.45	1157	1.58	1210	1.71	1258	3 HP	2300
2400		0.84	855	0.98	930	1.12	998	1.27	1060	1.42	1118	1.55	1172	1.69	1224	1.82	1273		2400
2500		0.91	873	1.06	947	1.21	1014	1.36	1075	1.51	1133	1.66	1187	1.80	1239	1.94	1287		2500
2600		0.99	891	1.14	964	1.30	1030	1.46	1091	1.61	1149	1.76	1202	1.92	1254	2.06	1302		2600
2700	1 1/2 HP	1.07	909	1.23	981	1.39	1046	1.55	1107	1.72	1164	1.88	1217	2.03	1269	2.19	1316	3 HP	2700
2800		1.15	927	1.32	998	1.49	1062	1.66	1122	1.83	1179	1.99	1232	2.16	1284	2.32	1331		2800
2900		1.24	945	1.41	1015	1.59	1079	1.76	1138	1.94	1195	2.11	1247	2.28	1298	2.45	1345		2900
3000		1.33	963	1.51	1032	1.69	1095	1.87	1154	2.05	1210	2.23	1262	2.41	1313	2.59	1360		3000

7.13 NU2540 HRV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP = 2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
2400	1 HP	0.9	896	1.05	967	1.19	1032	1.34	1092	1.48	1149	1.62	1202	1.76	1251	1.89	1299	2 HP	2400
2500		0.98	914	1.13	984	1.28	1048	1.43	1108	1.58	1164	1.73	1216	1.88	1266	2.02	1313		
2600	1 1/2 HP	1.06	931	1.22	1000	1.37	1063	1.53	1122	1.69	1178	1.84	1231	2	1281	2.15	1328	3 HP	2600
2700		1.14	947	1.31	1015	1.47	1078	1.63	1137	1.79	1192	1.95	1245	2.12	1294	2.28	1342		
2800		1.23	963	1.4	1031	1.57	1093	1.73	1151	1.9	1206	2.07	1258	2.24	1308	2.41	1355		
2900		1.32	979	1.49	1046	1.67	1107	1.84	1165	2.02	1220	2.19	1272	2.36	1321	2.54	1368		
3000		1.41	994	1.59	1060	1.77	1122	1.95	1179	2.13	1233	2.31	1285	2.49	1334	2.67	1381		
3100		1.5	1009	1.69	1075	1.88	1135	2.07	1193	2.25	1246	2.44	1298	2.63	1346	2.81	1393		
3200		1.6	1023	1.8	1089	1.99	1149	2.18	1206	2.37	1259	2.57	1310	2.76	1359	2.95	1405		
3300	2 HP	1.7	1037	1.9	1102	2.1	1162	2.3	1219	2.5	1272	2.7	1323	2.9	1371			N/A	3300
3400		1.82	1054	2.02	1118	2.23	1178	2.43	1233	2.64	1286	2.84	1337						
3500		1.93	1067	2.14	1131	2.35	1190	2.56	1246	2.77	1298	2.98	1349						
3600	3 HP	2.04	1080	2.26	1143	2.47	1203	2.69	1258	2.91	1310							N/A	3600
3700		2.15	1093	2.38	1156	2.6	1215	2.82	1270										
3800		2.27	1106	2.5	1168	2.73	1226	2.96	1282										
3900		2.4	1122	2.64	1182	2.87	1240												
4000		2.53	1134	2.77	1194														

7.14 NU2540 HRV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP = 2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
1600	1/2 HP	0.46	785	0.55	859	0.64	926	0.73	988	0.82	1045	0.91	1099	1.01	1150	1.1	1199	1 1/2 HP	1600
1700	3/4 HP	0.52	809	0.62	882	0.71	948	0.81	1003	0.9	1066	1	1119	1.1	1169	1.2	1217		
1800		0.58	832	0.69	904	0.79	969	0.89	1029	0.99	1085	1.09	1138	1.19	1188	1.3	1236		
1900		0.65	855	0.76	926	0.87	990	0.98	1049	1.08	1105	1.19	1157	1.3	1206	1.4	1254		
2000		0.72	877	0.84	947	0.96	1010	1.07	1069	1.18	1124	1.29	1175	1.4	1225	1.52	1271		
2100	1 HP	0.8	901	0.92	969	1.05	1032	1.17	1090	1.28	1144	1.4	1195	1.52	1244	1.64	1291	2 HP	2100
2200		0.87	922	1.01	989	1.14	1051	1.27	1109	1.39	1162	1.51	1213	1.64	1261	1.76	1308		
2300		0.95	942	1.09	1008	1.23	1070	1.37	1127	1.5	1180	1.63	1231	1.76	1278	1.88	1324		
2400	1 1/2 HP	1.04	962	1.18	1027	1.33	1088	1.47	1144	1.61	1198	1.75	1248	1.88	1295	2.02	1341	3 HP	2400
2500		1.13	981	1.28	1045	1.43	1105	1.58	1161	1.73	1214	1.87	1264	2.01	1312	2.15	1357		
2600		1.22	1002	1.38	1066	1.54	1125	1.69	1180	1.85	1233	2	1282	2.15	1330	2.3	1375		
2700		1.32	1020	1.48	1083	1.64	1142	1.81	1197	1.97	1249	2.13	1298	2.29	1345	2.44	1390		
2800		1.42	1038	1.59	1100	1.76	1158	1.92	1213	2.09	1264	2.26	1313	2.43	1360	2.59	1405		
2900	2 HP	1.53	1058	1.7	1119	1.88	1177	2.05	1231	2.23	1282	2.4	1330	2.57	1377	2.75	1422	2 HP	2900
3000		1.63	1075	1.81	1136	2	1192	2.18	1246	2.36	1297	2.54	1345	2.72	1392	2.9	1436		

7.15 NU2540 ERV

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1.00		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP =2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
2400	1 1/2 HP	1.08	981	1.22	1044	1.37	1104	1.51	1159	1.65	1212	1.84	1280	1.92	1308	2.05	1353	3 HP	2400
2500		1.17	1002	1.32	1065	1.47	1124	1.62	1179	1.77	1231	1.92	1280	2.06	1326	2.2	1371		2500
2600		1.27	1021	1.42	1083	1.58	1141	1.74	1195	1.89	1247	2.05	1296	2.19	1342	2.34	1387		2600
2700		1.37	1041	1.53	1102	1.7	1160	1.86	1214	2.02	1265	2.18	1313	2.34	1360	2.49	1404		2700
2800		1.48	1061	1.65	1122	1.82	1178	1.98	1232	2.15	1282	2.32	1331	2.49	1377	2.65	1421		2800
2900	2 HP	1.58	1078	1.76	1138	1.93	1194	2.11	1247	2.28	1298	2.45	1346	2.63	1392	2.8	1436	N/A	2900
3000		1.7	1098	1.88	1157	2.06	1212	2.24	1265	2.42	1315	2.6	1362	2.78	1408	2.96	1452		3000
3100		1.82	1116	2.01	1175	2.19	1230	2.38	1282	2.57	1331	2.75	1378	2.94	1424				3100
3200	3 HP	1.94	1135	2.14	1192	2.33	1247	2.52	1298	2.71	1347	2.91	1394					3200	
3300		2.07	1153	2.27	1210	2.47	1264	2.67	1315	2.87	1363							3300	
3400		2.2	1171	2.41	1227	2.61	1280	2.82	1331									3400	
3500		2.34	1188	2.55	1244	2.76	1296	2.97	1347									3500	
3600		2.48	1205	2.7	1260	2.91	1312											3600	
3700		2.63	1221	2.85	1276													3700	
3800		2.77	1237															3800	
3900		2.93	1253															3900	
4000																	4000		

7.16 NU2540 ERV Face and Bypass

CFM	Motor Size	ESP = 0.25		ESP = 0.50		ESP = 0.75		ESP = 1		ESP = 1.25		ESP = 1.50		ESP = 1.75		ESP =2.00		Motor Size	CFM
		BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM		
1600	3/4 HP	0.57	876	0.66	942	0.75	1002	0.84	1059	0.94	1112	1.03	1162	1.12	1210	1.22	1256	1 1/2 HP	1600
1700		0.65	904	0.74	968	0.84	1027	0.93	1083	1.03	1135	1.13	1185	1.23	1232	1.33	1278		1700
1800		0.73	931	0.83	994	0.93	1052	1.03	1107	1.13	1158	1.24	1207	1.34	1254	1.44	1299		1800
1900	1 HP	0.82	960	0.93	1021	1.03	1078	1.14	1132	1.24	1183	1.35	1231	1.46	1278	1.57	1322	2 HP	1900
2000		0.92	988	1.03	1048	1.14	1104	1.25	1157	1.36	1207	1.47	1255	1.59	1300	1.7	1344		2000
2100	1 1/2 HP	1.01	1013	1.13	1072	1.25	1127	1.36	1179	1.48	1229	1.6	1276	1.72	1321	1.84	1364	3 HP	2100
2200		1.11	1039	1.24	1098	1.37	1152	1.49	1203	1.61	1252	1.73	1299	1.86	1343	1.98	1386		2200
2300		1.22	1065	1.36	1122	1.49	1176	1.62	1227	1.75	1275	1.87	1321	2	1365	2.13	1407		2300
2400		1.33	1090	1.48	1146	1.62	1200	1.75	1249	1.89	1297	2.02	1343	2.15	1386	2.29	1428		2400
2500		1.45	1114	1.6	1170	1.75	1222	1.89	1272	2.03	1319	2.17	1364	2.31	1407	2.45	1449		2500
2600	2 HP	1.57	1138	1.73	1193	1.89	1245	2.04	1294	2.19	1340	2.33	1385	2.48	1428	2.62	1469	N/A	2600
2700		1.7	1162	1.86	1216	2.03	1267	2.19	1315	2.35	1362	2.5	1406	2.65	1448	2.8	1489		2700
2800		1.84	1187	2.01	1240	2.18	1290	2.35	1338	2.51	1384	2.67	1428	2.83	1470	2.99	1510		2800



8 ELECTRICAL DATA

8.1 Motors – all units

Mtr Data																				
Voltage																				
hp	240/1										208/3									
	Stock	Type	Frame	RPM	Shaft	S.F.	Eff.	FLA	MCA	MOP	Stock	Type	Frame	RPM	Shaft	S.F.	Eff.	FLA	MCA	MOP
1/2	C612	TEFC	56	1725	5/8	1.15	67.1	3.6	9.1	15	H868	TEFC	56	1725	5/8	1.15	80.4	1.6	4.6	15
3/4	C669	TEFC	56	1725	5/8	1.15	69.3	5.2	12.7	20.0	H869	TEFC	56	1725	5/8	1.15	79.3	2.4	6.4	15
1	C683	TEFC	56	1725	5/8	1.15	71.0	7.5	17.9	25.0	H524	TEFC	56	1725	5/8	1.15	79.0	3.3	8.4	15
1.5	C693	TEFC	56	1725	5/8	1.15	72.0	7.5	17.9	25.0	H535	TEFC	56	1725	5/8	1.15	82.9	4.5	11.1	15.0
2	K200	TEFC	182T	1750	7/8	1.15		12.0	28.0	40.0	TE115	TEFC	145T	1730	7/8	1.15	86.5	5.6	13.6	20.0
3	K203	TEFC	184T	1725	7/8	1.15		16.0	37.0	55.0	TE121	TEFC	182T	1745	1 1/8	1.15	89.5	8.4	19.9	30.0
Voltage																				
hp	460/3										575/3									
	Stock	Type	Frame	RPM	Shaft	S.F.	Eff.	FLA	MCA	MOP	Stock	Type	RPM	Frame	Shaft	S.F.	Eff.	FLA	MCA	MOP
1/2	H868	TEFC	56C	1725	5/8	1.15	80.4	0.9	3.0	15	H276	TENV	1725	56	5/8	1.15	77.0	0.7	2.6	15
3/4	H869	TEFC	56C	1725	5/8	1.15	79.3	1.2	3.7	15	H461	TENV	1725	56	5/8	1.15	82.0	0.8	2.8	15
1	H524	TEFC	56C	1725	5/8	1.15	79.0	1.7	4.8	15	H525	TEFC	1725	56	5/8	1.15	81.0	1.4	4.2	15
1.5	H535	TEFC	56HC	1725	5/8	1.15	82.9	2.2	6.0	15	TE109	TEFC	1740	145T	7/8	1.15	86.5	1.6	4.6	15
2	TE115	TEFC	145T	1730	7/8	1.15	86.5	2.5	6.6	15	TE116	TECF	1730	145T	7/8	1.15	86.5	2.2	6.0	15
3	TE121	TEFC	182T	1760	1 1/8	1.15	89.5	3.8	9.6	15	TE122	TEFC	1760	182T	1 1/8	1.15	89.5	3.1	8.0	15
MCA = Minimum circuit amps MOP = Maximum over-current protection Chose a standard sized overcurrent device equal or less than the																				
MCA = Minimum circuit amps MOP = Maximum over-current protection Chose a standard sized overcurrent device equal or less than the MOP																				
MCA & MOP are the HRV unit total based on both motors (supply and exhaust) being equal hp																				
For unequal motors: MCA = FLA(larger mtr)*1.25 + FLA(smaller mtr) + 1 MOP = FLA(larger mtr)*2.25 + FLA(smaller mtr) + 1 rounded down to																				

8.2 Electrical Schematics

Several common electrical schematics are found in the following pages. The “as built” schematic for each unit is supplied with the equipment and is available from the factory by request.

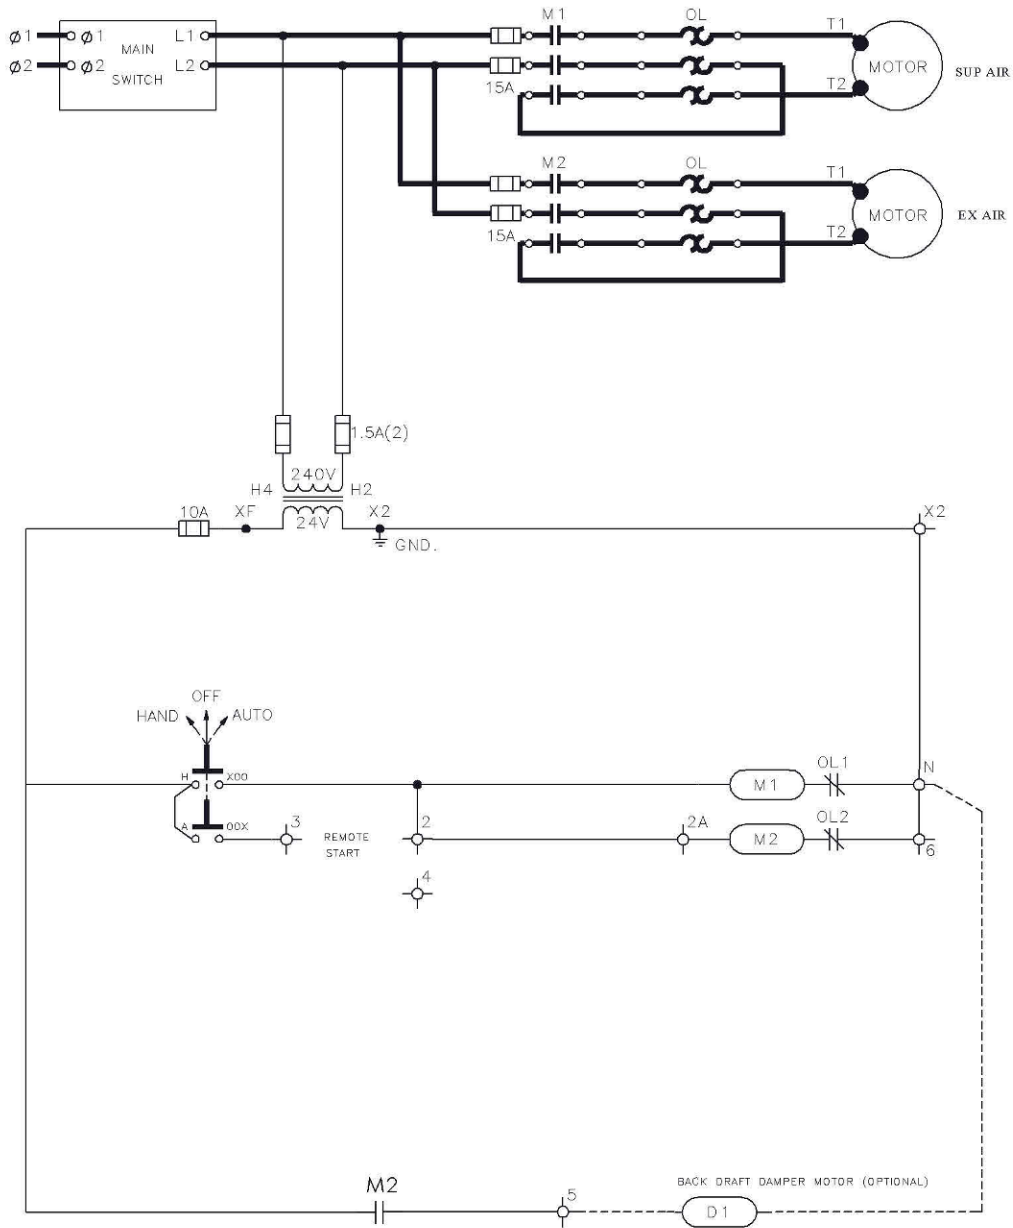

Dirty filter Contacts (DF) connect to 1A and DF. 24 VAC NO as shown. Remove jumper 1-1A for dry contacts



M1




Use auxiliary contacts M1 and/or M2 to interlock with other equipment. M1 and M2 are N.O., dry and close when the motor is operating. Field wiring is done at the contact block. i.e. terminals not provided.

1	
1A	
2	
2A	
3	
4	
5	
5	
6	
N	
N	
N	
DF1	
DF2	



SINGLE PHASE NO DEFROST

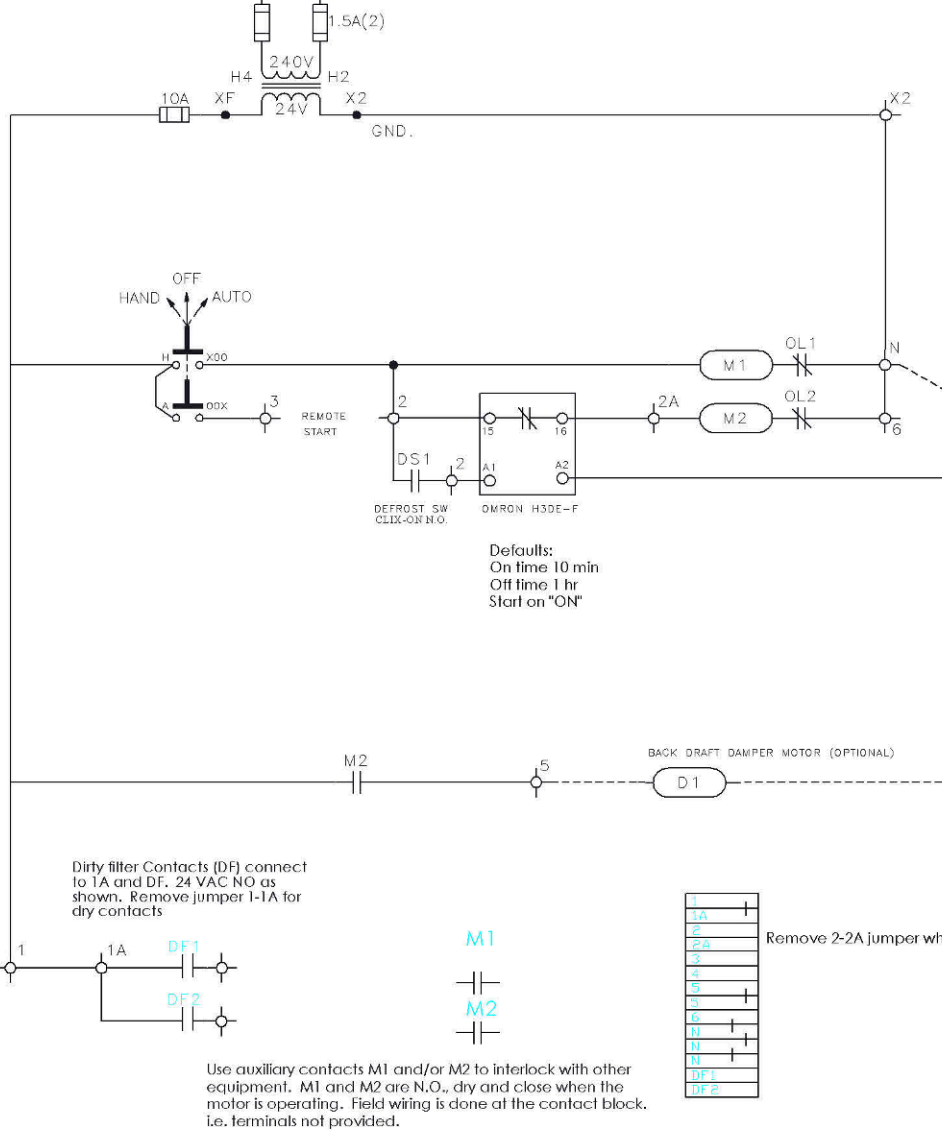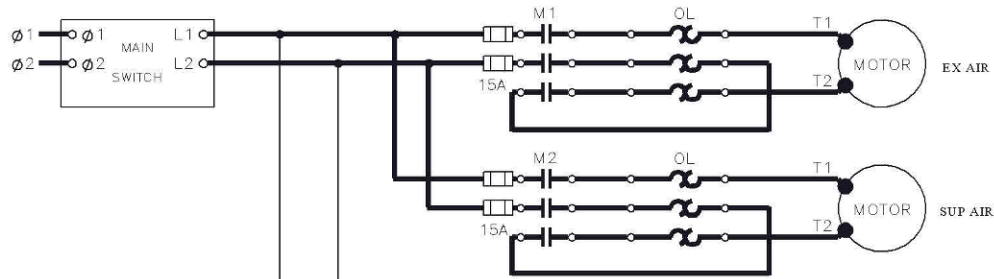

SINGLE PHASE TIMED FAN

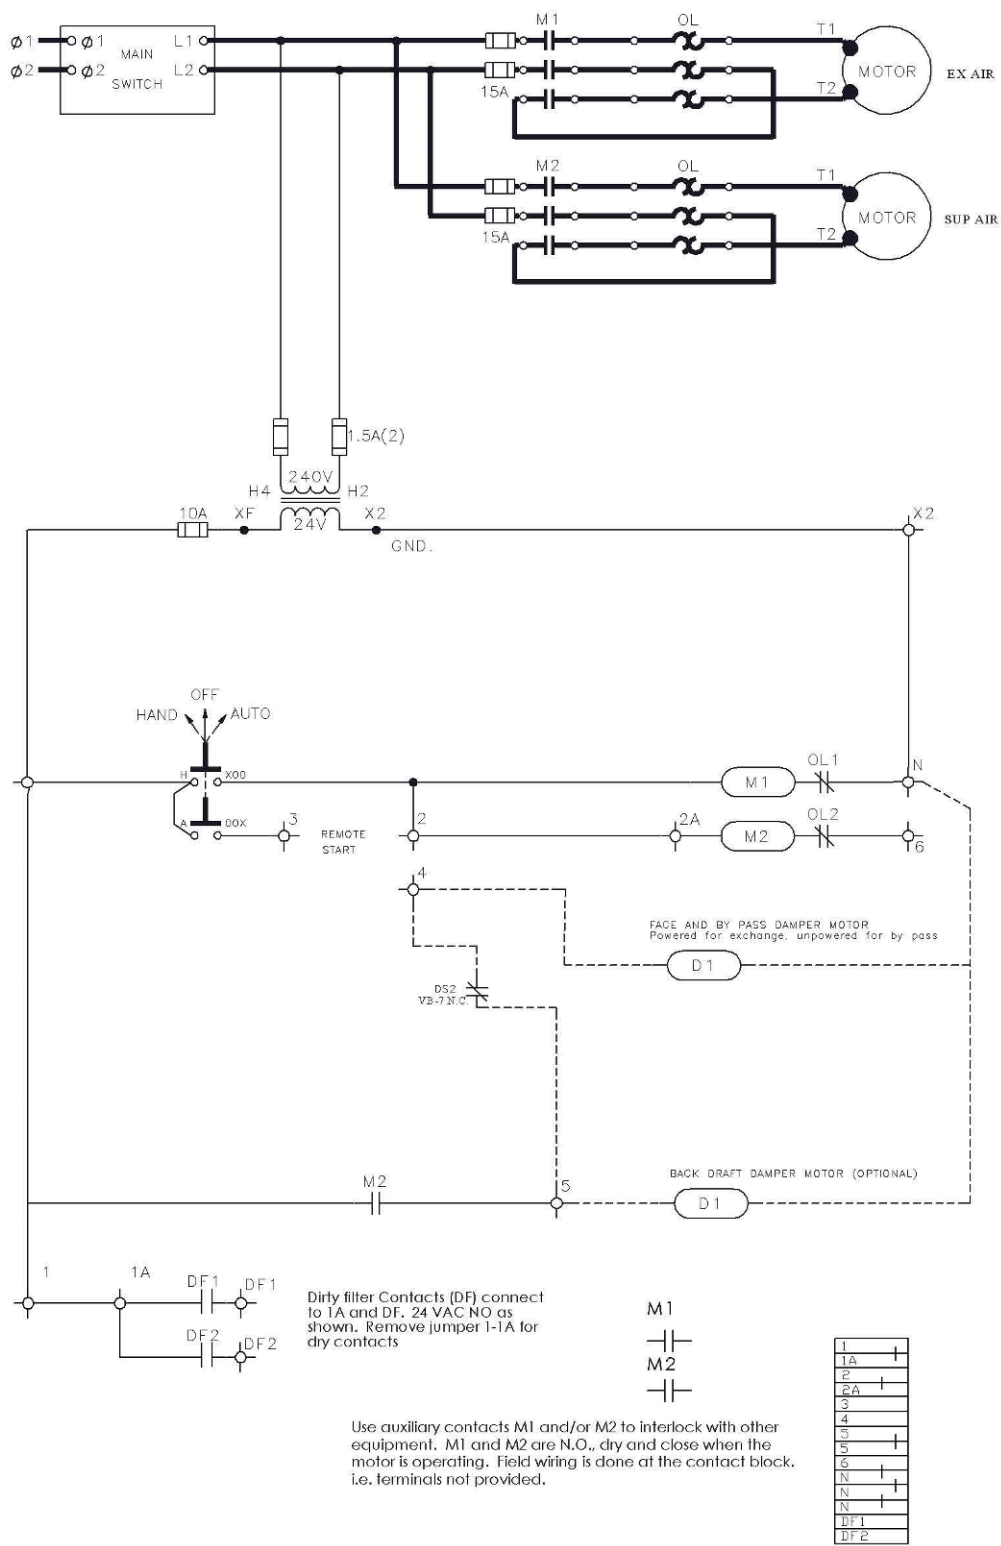

SINGLE PHASE FACE AND BY PASS

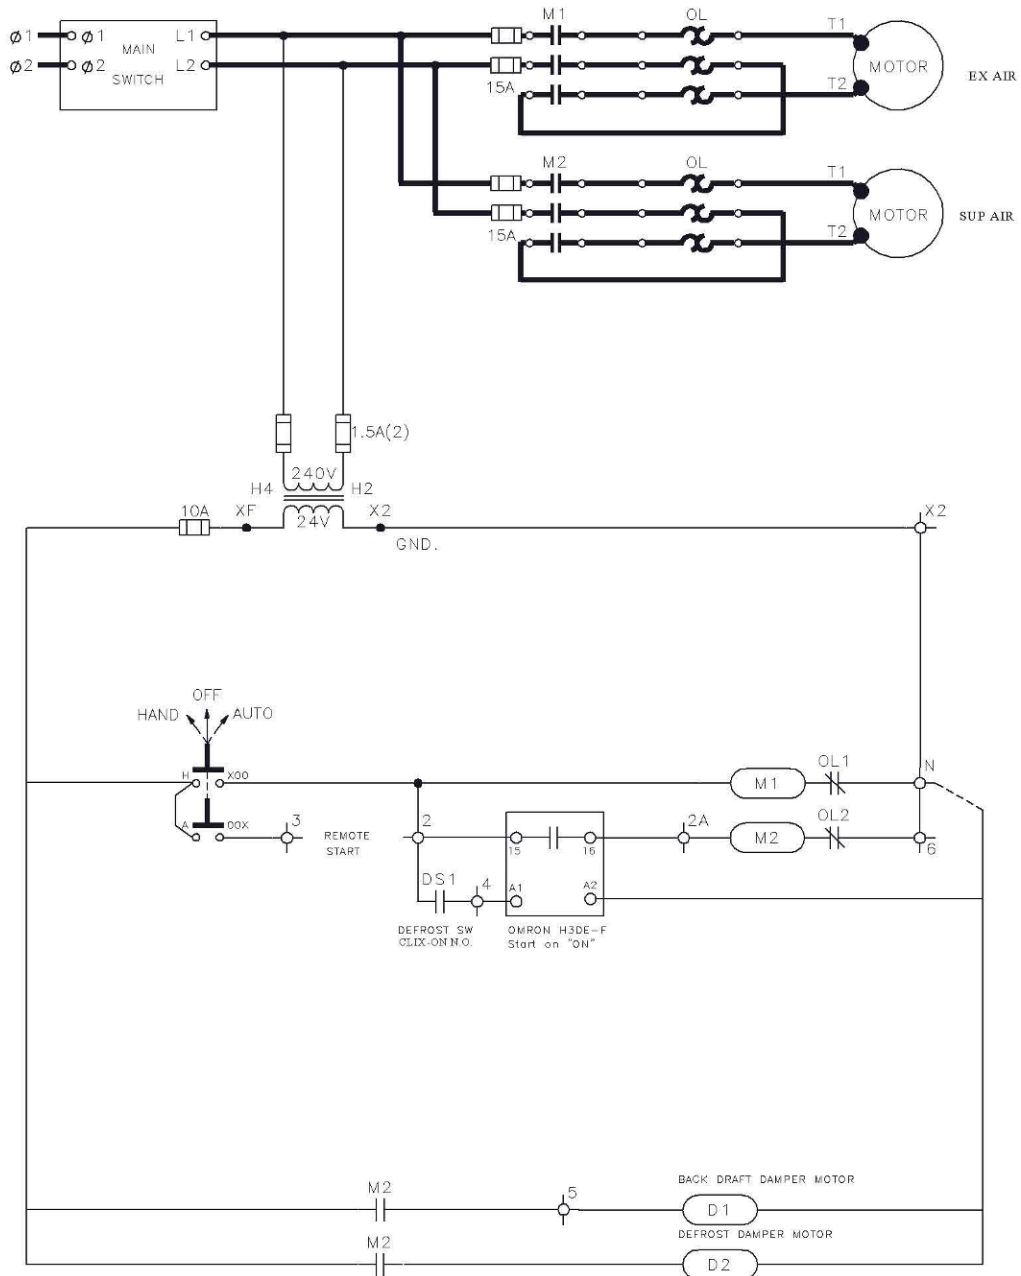

Dirty filter Contacts (DF) connect to 1A and DF. 24 VAC NO as shown. Remove jumper 1-1A for dry contacts


M1




Use auxiliary contacts M1 and/or M2 to interlock with other equipment. M1 and M2 are N.O., dry and close when the motor is operating. Field wiring is done at the contact block. I.e. terminals not provided.

1	
1A	
2	
2A	
3	
4	
5	
5	
6	
N	
N	
N	
DF1	
DF2	


SINGLE PHASE RECIRC DEFROST

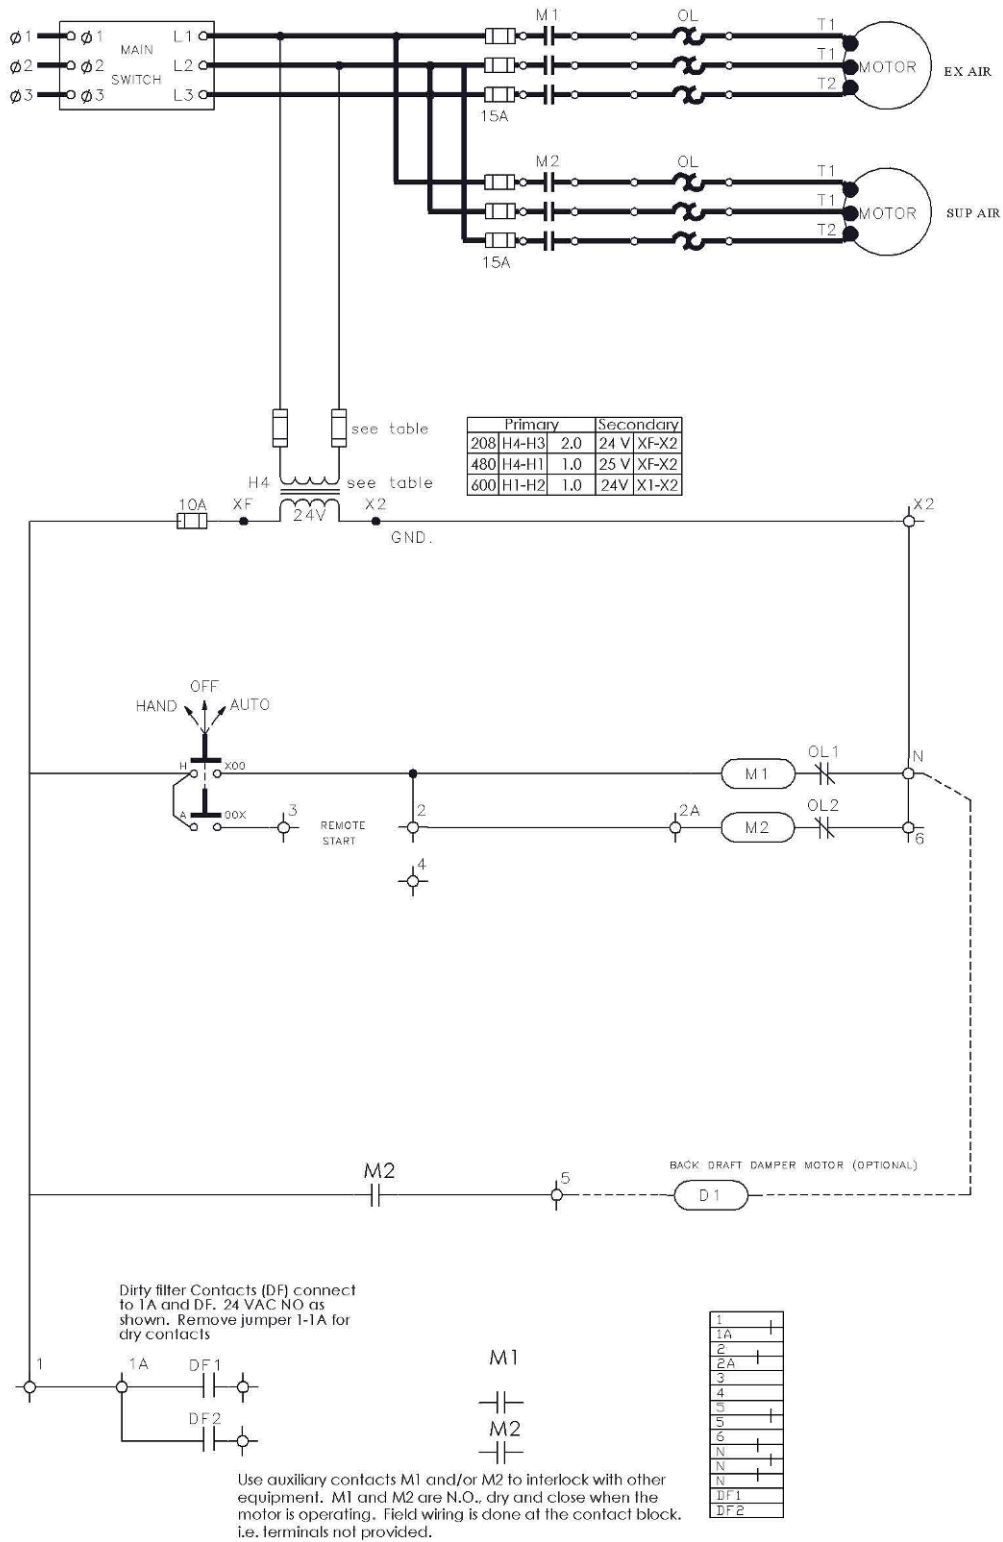


THREE PHASE NO DEFROST

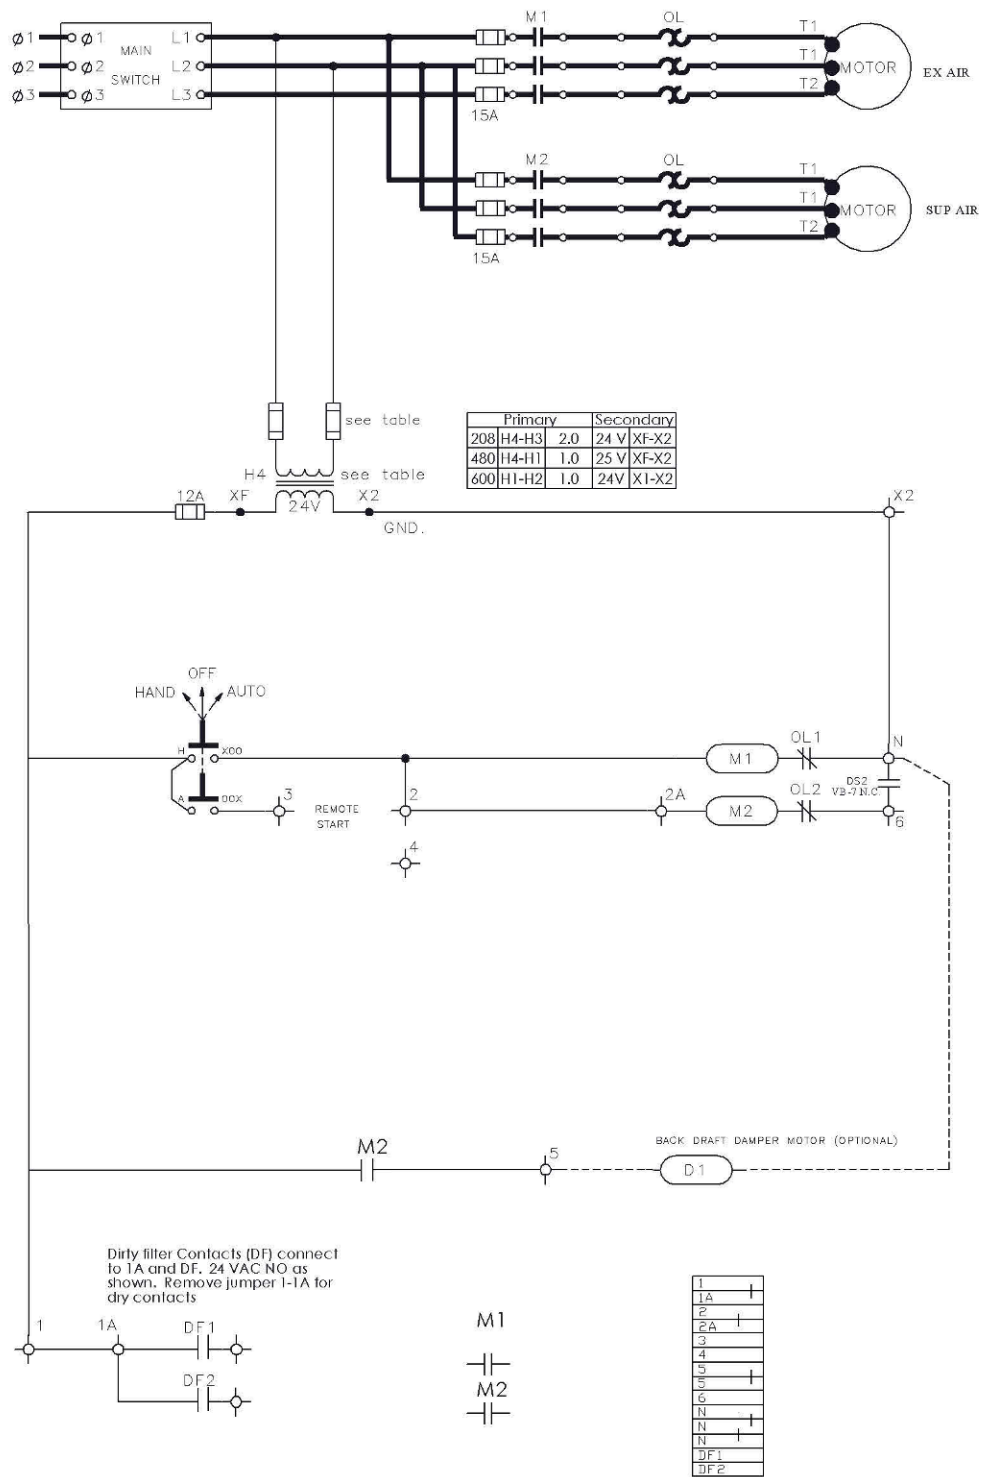

THREE PHASE FAN DEFROST

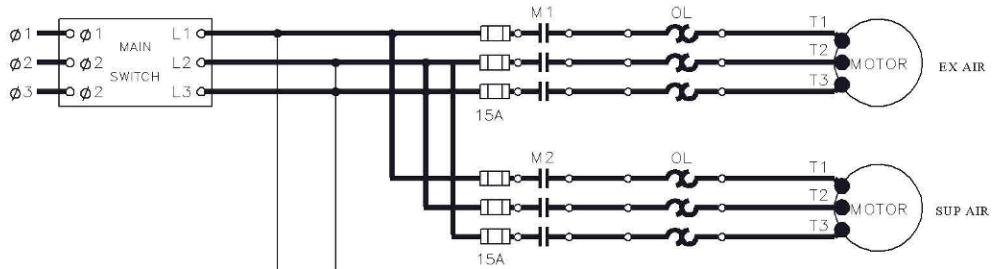

Primary	Secondary
208 H4-H3	2.0 24 V XF-X2
480 H4-H1	1.0 25 V XF-X2
600 H1-H2	1.0 24V X1-X2

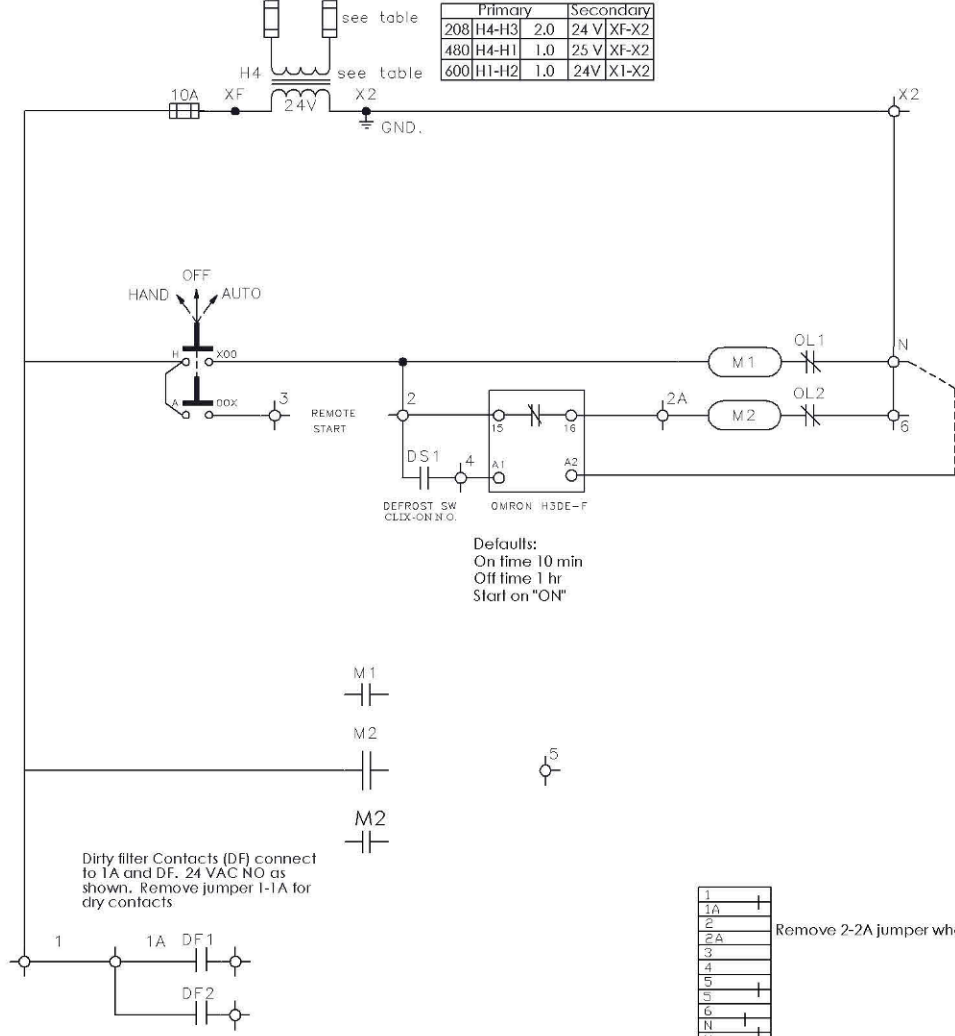

Defaults:
 On time 10 min
 Off time 1 hr
 Start on "ON"


Dirty filter Contacts (DF) connect to 1A and DF. 24 VAC NO as shown. Remove jumper 1-1A for dry contacts

1	+
1A	+
2	
2A	
3	
4	
5	
6	
N	+
N	+
N	+
DF1	
DF2	


Remove 2-2A jumper when using timer

Use auxiliary contact M2 to interlock with other equipment. M1 and M2 are N.O., dry and close when the motor is operating. Field wiring is done at the contact block. i.e. terminals not provided.

THREE PHASE TIMED FAN

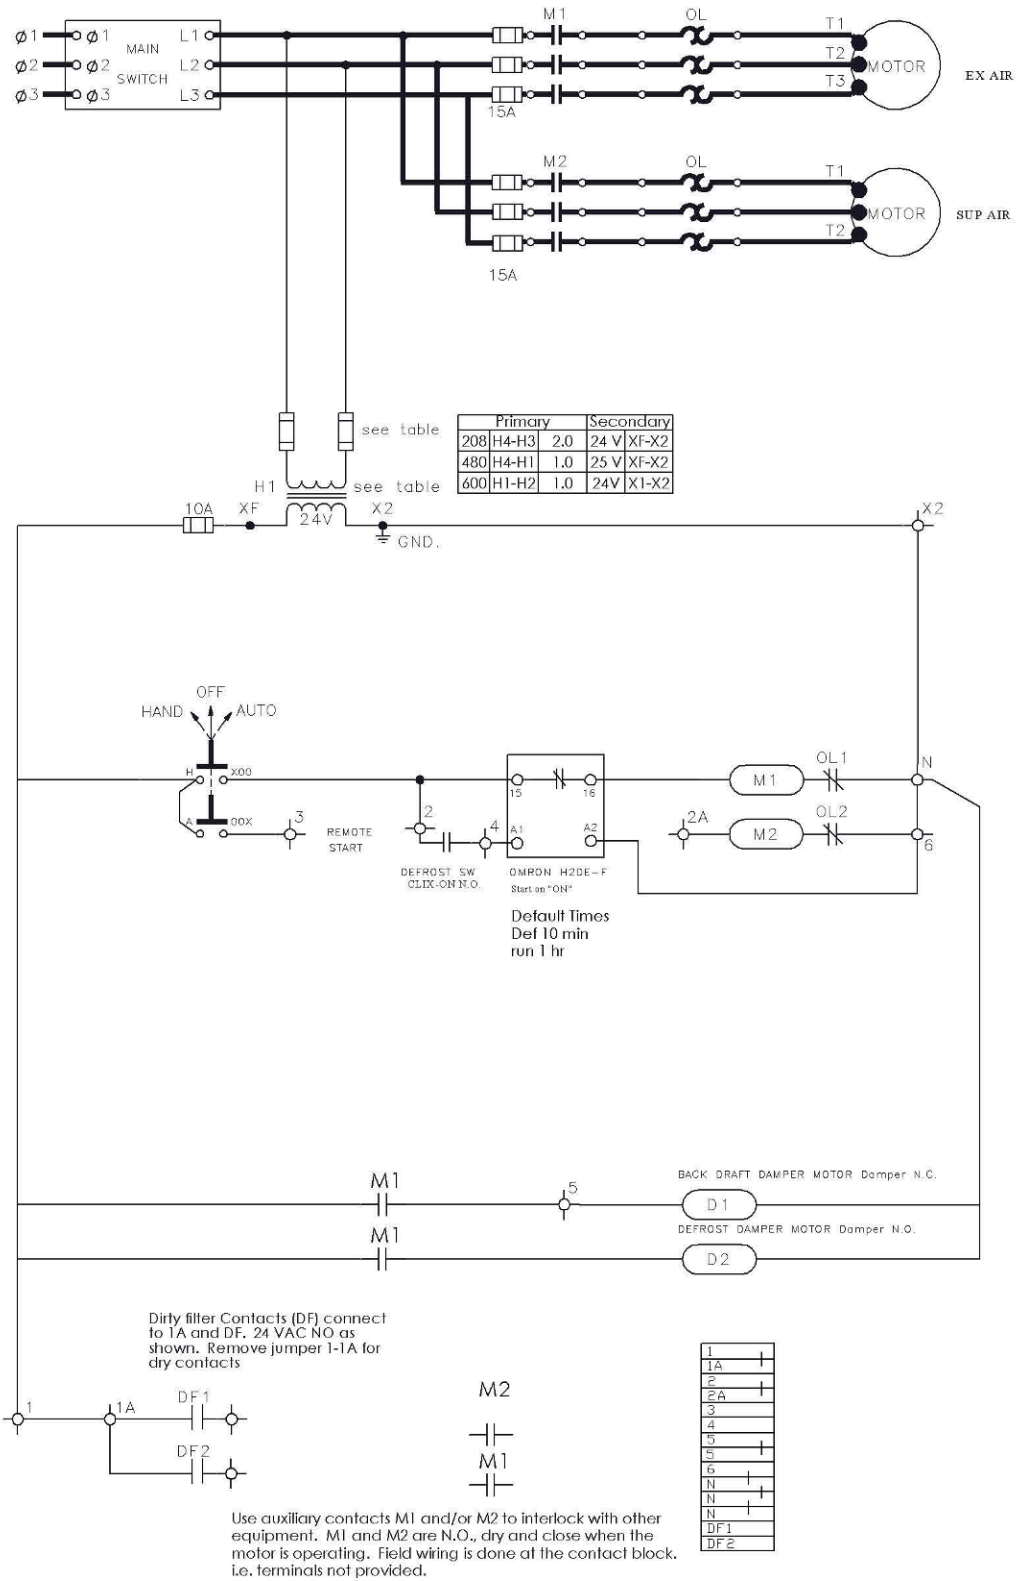

THREE PHASE RECIRC DEFROST

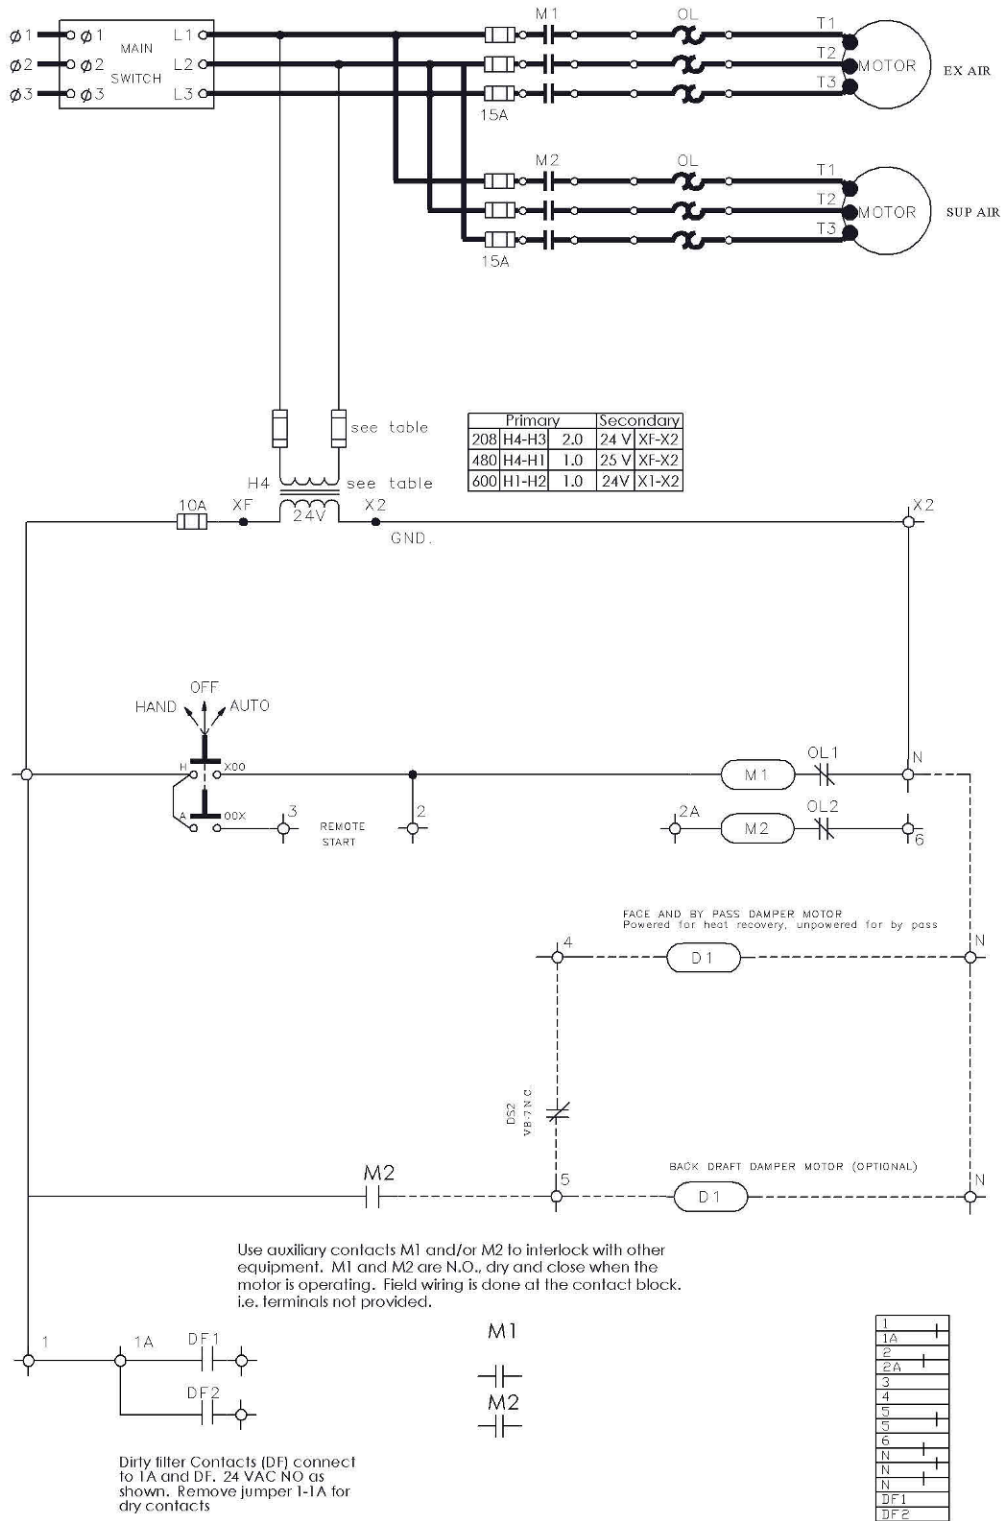

THREE PHASE FACE AND BY PASS

9 INSTALLATION

The HRV motors are controlled and protected by a multi-starter which includes a disconnect switch. A Hand/Off/Auto selector is located on the starter for local or remote switching.

9.1 Remote Control

Any dry contact switch closure may be used. Control voltage is 24 VAC.

9.1.1 INSTALLATION INSTRUCTIONS

9.1.1.1 Installer's Responsibilities

Installers are responsible for the performance of the ventilation system and for ensuring that all codes and standards are met.

- Do not mount the fresh air supply near a source of contaminated air such as automotive exhaust, gas or propane exhaust or oil tanks.
- Combustion appliances such as furnaces and hot water heaters must not draw combustion air directly from an HRV.


9.2 Installation Basics

ASHRAE Standard 62-99 recommends the following. Ventilation systems should be designed to prevent re-entrainment of exhaust contaminants, condensation or freeze-ups and growth of microorganisms. Make-up air inlets and exhaust air outlets shall be located to avoid contamination of the makeup air. Contaminants from sources such as cooling towers, sanitary vents, vehicular exhaust, and street traffic should be avoided.


9.3 Mounting The Unit (Roof Top Units)

1. Determine where the unit is to be located on the roof
2. Refer to the unit detail drawing for roof openings and cut accordingly
3. Place the curb on the roof and ensure it is level
4. Flash the curb with roofing membrane tying in to the wood nailer. Do not attach flashing to the H/ERV.

5. Apply the foam gasket to all top flanges of the curb forming a continuous, watertight seal.
6. With the HRV lifted, connect the drain hose to the spouts from underneath, feed the fresh air hose through the center curb member and tee into the exhaust drain.
7. Lift the unit onto the curb. Do not drag on the roof.
8. Tie in the supply and return ducts, electrical wiring and run condensate drain into the conditioned space through the exhaust air duct.
9. Do not drain to the roof.

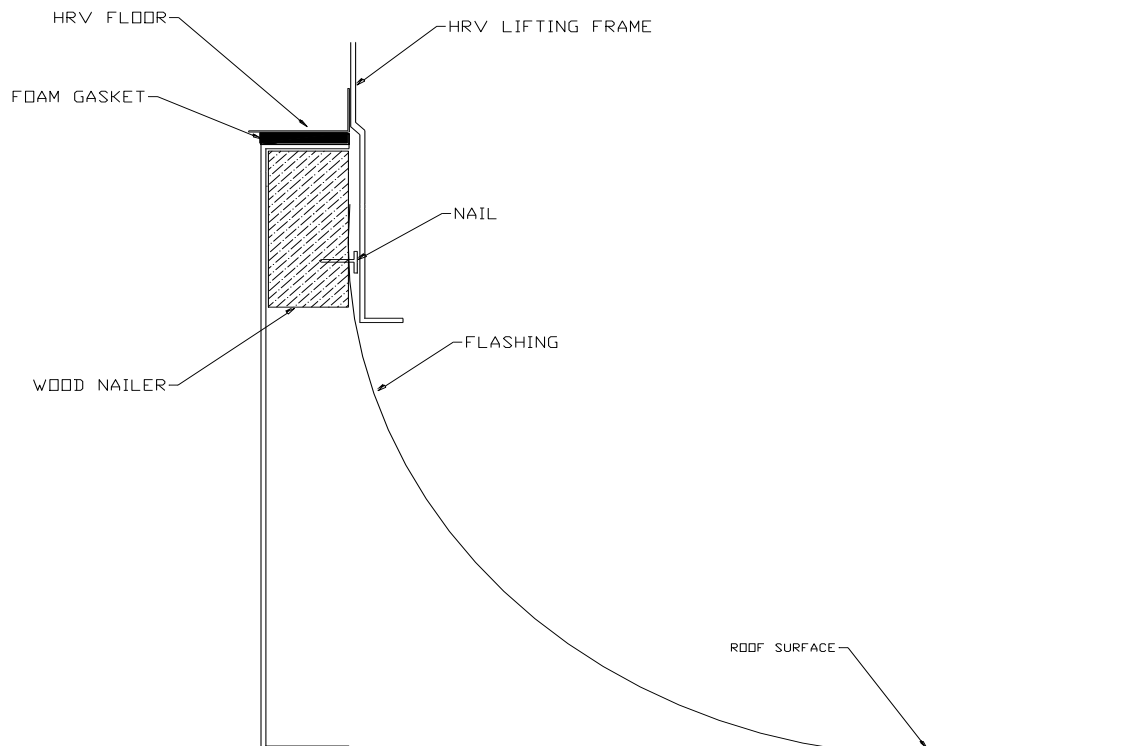

9.4 Connecting the Condensate Drain

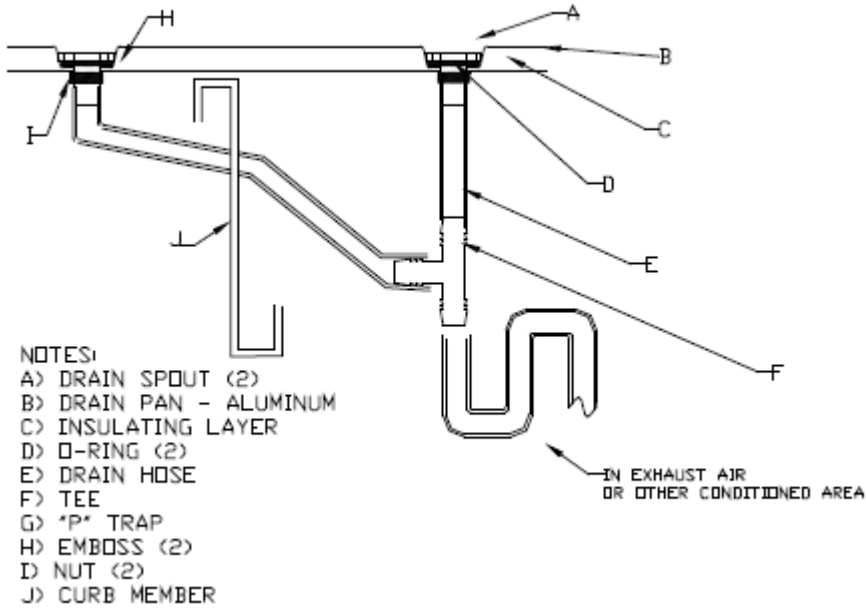

NU1030, NU2035 and NU2540 units feature 3/4 FPT fitting which can be used to connect to building drainage system.

9.5 Connecting To Other Equipment

If the HRV is used upstream of an air handler or similar equipment (e.g. fresh air into economizer section), the startup sequence must be HRV first followed by the air handler. If the air handler is started first, the HRV's fresh air fan will rotate

backward and the motor may not be able to overcome the extra load causing the motor to over amp and potentially damage the blower wheel.

9.6 Controls And Electrical Connection

A single point connection of mains power in the starter box powers the HRV. HRV must be connected to a power source of voltage and phase indicated on the starter box and according to applicable local electrical codes.

9.7 Balancing The System

Unless otherwise specified by the system designer, set up the HRV with balanced supply and exhaust air flows.

The pulleys used on the supply and exhaust motors are a split type that allows some field adjustment of the fan rpm and corresponding air flow. Adjust the pulley in $\frac{1}{2}$ turn increments. **Close to increase rpm, open to decrease rpm.**

Once the HRV system is installed, do the following:

- Close all windows and doors.
- Turn off any exhaust only systems.
- To balance the HRV, set the machine on high speed.
- Make a small hole in the supply duct at least 10 feet downstream of the fan. Insert a Pitot tube in the cross sectional center of the duct.
- Measure the pressure with a digital manometer or magnehelic gauge.
- Record the value and repeat the procedure for the exhaust air stream.
- Install a balancing damper in the air stream with the greater flow and damper back until the pressure equals that of the opposite air stream.

At this point the unit is ready for final air balancing.

The fan rpm and cfm have been factory set to as near as practical to the specified level. A certified air balancer will fine tune the air flows using dampers and adjusting the motor's pulleys if needed. During the air balancing procedure, the balancer will measure the amp draw of each motor with all access covers closed and ensure it is less than the rated FLA. If the amp draw is greater than the FLA plus service factor, the fan rpm must be lowered. A final balancing report will include fan and motor rpm, individual and total motor amps, voltage on each leg, unit and branch duct cfm, external static pressure in each duct.

Commissioning is considered complete with the final air balance and report.

10 MAINTENANCE

CAUTION: *Disconnect power before servicing.*

a. FILTERS

Dirty filters can reduce ventilation efficiency, resulting in unbalanced airflow and damage or shorten the life of the motors. Check at least every three months and replace yearly or when necessary depending on indoor and outside air conditions.

Filters	NU0820	NU2035	NU1030	NU2540
Size	17.5x14x2”	23.5x14x2”	17x14x2”	23.5x14x2”
Quantity	6	6	6	6

Nu-Air recommends a spare set of filters be ordered with the HRV for maintenance stores.

b. FANS

When cleaning the filters, take the opportunity to vacuum any interior surfaces including the fan blades.

c. MOTORS

The motors are equipped with permanently sealed and lubricated bearings

d. BELTS

Inspect belts for wear and cracks. Replace as required. Inspect belts for misalignment and proper tension during maintenance.

e. CONDENSATE DRAIN

Twice per year wipe clean the condensate drain pan. Check the condensate drain and tubing to ensure they are free flowing. The tubing must have an "S" or loop that traps a quantity of water to prevent air from entering the HRV via this tubing.


f. CORE

For service, the core (heat exchanger) can be removed from the unit by sliding it (or core sections) forward on the guides. Observe proper orientation when replacing the core in the HRV. Observe the following practices for core cleaning:

- **HRV core** should be removed and cleaned at least once a year using a non-corrosive enzyme detergent in cold water.
- **ERV core** should be removed and cleaned at least once a year using a vacuum equipped with a gentle brush attachment—do not wash the ERV core(s) or use a rigid brush (e.g. hard plastic or steel bristles) as these practices will damage the core membrane material.

g. EXTERIOR HOODS

Regularly check the outside vents and clean any obstructions such as grass, leaves or other debris. Do not replace the screen with mesh smaller than 1/4" as this will restrict airflow. During winter operation, ensure snow and frost does not build up and restrict or block openings.

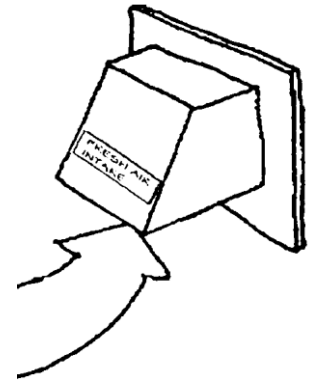

11 WARRANTY:

NU-AIR COMPLIANT SERIES HRV's & ERV's

Nu-Air warrants its Compliant Series HRV's and ERV's to be free from defects on all components including motors, circuit boards, transformers, and switches when subject to normal and proper use for a period of two (2) years from the date of purchase. Nu-Air warrants its Compliant Series HRV core to be free from defects for a period of 15 years. Nu-Air warrants its Compliant Series ERV core to be free from defects for a period of 5 years.

Should a manufacturing defect occur during the warranty period, Nu-Air will supply replacement parts FOB our plant at no charge. Labour costs to remove and reinstall these parts are not covered under this warranty.

This warranty is expressly in lieu of all other warranties or obligations and in no event shall Nu-Air be liable for consequential or incidental damages of any kind, including damage to the building, its contents or any person therein.



P.O. Box 2758, Windsor, Nova Scotia Canada, B0N 2T0

Phone: (902) 798 2261

Fax: (902) 798 2557

Email: nuair@nu-airventilation.com Website: www.nu-airventilation.com